

NATIONAL EXAMINATIONS

May 2015

07-MEC-B3 ENERGY CONVERSION AND POWER GENERATION

Three hours duration

Notes to Candidates

1. This is a **Closed Book** examination.
2. Examination paper consists of two Sections. **Section A is Calculative** with four (4) questions and **Section B is Descriptive** with two (2) questions.
3. Note that Question 4 is on two pages.
3. **Do three (3) questions (including all parts of each question) from Section A (Calculative) and one (1) question from Section B (Descriptive).**
4. **Four questions constitute a complete paper.** (Total 60 marks).
5. **All questions are of equal value.** (Each 15 marks).
6. If doubt exists as to the interpretation of any question or in the event of missing data, the candidate is urged to submit, with the answer paper, a clear statement of any assumptions made.
7. Candidates may use one of the approved **Casio** or **Sharp** calculators.
8. **Reference data** for particular questions are given on pages 9 to 12. **All pages used are to be returned with the answer booklet showing where data has been obtained.**
9. **Reference formulae and constants** are given on pages 13 to 16.
10. **Steam Tables** from "Thermodynamics and Heat Power" are provided.

SECTION A CALCULATIVE QUESTIONS**QUESTION 1 COMBINED CYCLE PLANT**

Refer to the Examination Paper Attachments Page 9 **Combined Cycle Plant**

In a combined cycle power plant based on a Brayton and a Rankine Cycle, as shown in the attached sketch on Page 9, the gas turbine exhaust heat is used to generate steam. The gas turbine cycle is an open cycle while the steam turbine cycle is a closed cycle with one stage of feedwater heating operating on the direct contact principle with steam bled from the turbine. The gas cycle has an air compressor, a combustion chamber, a gas turbine and a heat recovery steam generator. The steam cycle has, besides the heat recovery steam generator, a steam turbine, a steam condenser, a condensate pump, a direct contact heat exchanger and a feedwater pump. The combined cycle is illustrated on Page 9 with appropriate conditions given at various points.

Assume a cold air standard cycle (constant specific heats with $k = 1.4$). For a gas mass flow of 100 kg/s calculate the following:

- (a) Rate of heat input to combustion chamber. (1)
- (b) Mass flow rate of main steam. (1)
- (c) Mass flow rate of bled steam. (1)
- (d) Power (net) generated by gas turbine. (2)
- (e) Power generated by steam turbine. (2)
- (f) Efficiency of air compressor. (2)
- (g) Efficiency of gas turbine. (2)
- (h) Efficiency (internal) of steam turbine. (2)
- (i) Work done by pumps (1)
- (j) Overall efficiency of plant assuming that the power for the condensate and feedwater pumps is taken from the steam turbine output. (1)

[15 marks]

QUESTION 2 LOCOMOTIVE GAS TURBINE CYCLE

A gas turbine to drive a locomotive has the following technical specifications:

Combustion chamber pressure	600 kPa
Inlet air pressure	100 kPa
Inlet air temperature	20 °C
Exhaust gas pressure	100 kPa
Air mass flow rate	12 kg/s
Fuel mass flow rate	0.25 kg/s
Fuel calorific value	40 000 kJ/kg

Assume an ideal Brayton cycle with no losses in the compressor or turbine and constant specific heats based on air only. Neglect the mass increase due to the fuel flow.

- Calculate the temperatures at all key points in the cycle. (3)
- Sketch the process on a T-s diagram showing temperatures and pressures. (1)
- Calculate the power output from the unit. (2)
- Calculate the thermodynamic efficiency of the cycle. (2)

To recover some of the heat from the exhaust gases, this cycle is modified to include a heat exchanger to transfer heat to the air leaving the compressor but before entering the combustion chamber.

- Sketch a flow diagram for this modified system. (1)
- Sketch the new flow processes on a T-s diagram. (1)
- Calculate the amount of fuel required by this new arrangement to maintain the same turbine inlet temperature as with the original arrangement. (2)
- Determine the power output from the unit. (1)
- Calculate the thermal efficiency of the cycle. (1)
- State what advantages, if any, the new arrangement has over the original arrangement. (1)

[15 marks]

QUESTION 3 NANTICOKE GENERATING STATION

Refer to Examination Paper Attachments Page 10 **Nanticoke Generating Station** (for Part I) and Page 11 **Mollier Chart** (with pressure in bar) (for Part I and Part II).

PART I CYCLE AND PLANT EFFICIENCY

Using the data for Nanticoke do the following:

- (a) Sketch a flow diagram of the system and identify by numbering the key points at which the enthalpies will be determined. Sketch a T-s diagram showing the components or processes and identify by numbering the same key points. (2)
- (b) Calculate the enthalpy of the water entering the boiler and the superheated steam leaving the boiler. (2)
- (c) Calculate the enthalpy of the reheated steam entering and leaving the boiler. (2)
- (d) Calculate the thermal efficiency of the boiler defined as heat absorbed by the steam over heat input by the fuel. (1)
- (e) Calculate the cycle efficiency of the steam system defined as electrical output of the generator over heat absorbed by the steam. (1)
- (f) Calculate the overall efficiency of the plant defined as electrical output of the generator over heat input by the fuel. (1)
- (g) Explain why the efficiencies in (e) and (f) are different. (1)

(10 marks)

PART II STEAM TURBINE EFFICIENCY

Assuming that, at Nanticoke, the turbine exhaust pressure is 0.005 MPa (0.05 bar) and the turbine exhaust wetness is 5%, do the following noting that 1 bar = 100 kPa:

- (a) Plot the turbine expansion lines for both low pressure and high pressure turbines on the Mollier Chart.
- (b) Determine, from the Mollier Chart, the internal efficiency of both the low pressure and high pressure turbines.

(5 marks)

[15 marks]

QUESTION 4 POWER PLANT HEAT DISCHARGE AND COOLING TOWERS**PART I HEAT DISCHARGE**

Thermal power plants operating on a Rankine Cycle reject considerable quantities of heat to a cooling system via a condenser. If the cooling medium is water in an open loop with the environment it can cause significant thermal pollution of a river or lake at the point of discharge. Consider (i) a CANDU Nuclear Plant, and (ii) a Coal Fired Fossil Plant each of 1000 MW electrical output.

- (a) Determine the total rate of heat discharge in the cooling water for each.
- (b) Find the total rate of heat loss to the atmosphere for each.

Assume that the reactor is water cooled and the electrical equipment air cooled. Use the data given below for efficiencies:

CANDU Nuclear Plant steam cycle efficiency	0.33
Coal Fired Fossil Plant steam cycle efficiency	0.41
CANDU Nuclear Plant reactor thermal efficiency	0.99
Coal Fired Fossil Plant boiler thermal efficiency	0.94
Electrical Efficiency for both plants	0.96

Note: Boiler and reactor thermal efficiency is defined as heat output via steam or coolant over heat input from fuel.

(6 marks)

Assume that the temperature rise of the cooling water is limited to 10°C for the two plants (i) and (ii) above.

- (c) Determine the flow rate (m^3/s) of cooling water required for each.
- (d) Determine the quantity of cooling water required per unit generated (m^3/kWhr) for each.

Specific heat of water: $c_p = 4.19 \text{ kJ/kg}^\circ\text{C}$

(3 marks)

Question 4 continued on next page

Question 4 continued.**PART II COOLING TOWER**

Refer to the Examination Paper Attachments Page 12 **Cooling Tower Evaporative Loss.**

A coal fired power plant with an electrical output of 600 MW rejects 1500 MJ/s of heat to the atmosphere via a steam condenser and a wet natural draught cooling tower. Operating conditions are as follows:

Steam inlet (turbine exhaust) temperature	30°C
Cooling water inlet temperature	15°C
Cooling water outlet temperature	25°C
Ambient air temperature	30°C.
Relative air humidity	40%

Determine the following:

- (a) Flow rate of cooling water (m^3/s)
- (b) Evaporative loss in cooling tower (m^3/GJ)
- (c) Evaporative loss in cooling tower (m^3/s)
- (d) Percentage loss of cooling water (%)
- (e) Consumption of water by cooling tower (L/kWh generated) (litres/unit generated)

(6 marks)

[15 marks]

SECTION B DESCRIPTIVE QUESTIONS

Descriptive questions should be answered in essay form with sketches, if appropriate, and taking approximately one full page for every 5 marks. A full page means approximately 250 words unless diagrams take the place of some words.

QUESTION 5 FUEL CHARACTERISTICS

PART I FOSSIL FUEL

- (a) State what is meant by heating value and clarify the difference between higher heating value and lower heating value. State which one is commonly used.
- (b) Compare and state the characteristics (constituents and heating value) of coals of different grade or rank. Indicate how and why these characteristics change according to the degree of transformation from vegetal matter to coal.
- (c) With regard to coal, state what constitutes a Proximate Analysis and what constitutes an Ultimate Analysis. Clarify the usefulness of each.

(9 marks)

PART II NUCLEAR FUEL

For a nuclear reactor of your choice:

- (a) Describe the nuclear fission process. Clarify what fuel is used, how fission is initiated and what components are produced. State the basic requirements for a nuclear fuel and describe its properties.
- (b) Explain the design requirements of a nuclear reactor. Describe the main internal components and clarify what purpose they serve. Emphasis should be on how the chain reaction is maintained and how energy is produced and removed from the reactor core.

(6 marks)

[15 marks]

QUESTION 6 WIND TURBINES

- (a) Explain the basic principles of wind energy and show, in a suitable sketch, the changes in air pressure and velocity as the wind passes through the turbine blades.

(5)

- (b) Explain why the ideal or theoretical efficiency (maximum power obtained from wind/total power in wind) of a wind turbine is no more than 59.3%. Explain also why the actual power produced by a wind turbine is only about three quarters of this value, that is, about 45%.

(5)

- (c) Describe the operational limitations and possible environment effects (positive and negative) of large scale use of wind energy.


(5)

[15 marks]

NAME

QUESTION 1 COMBINED CYCLE PLANT

SYSTEM DIAGRAM

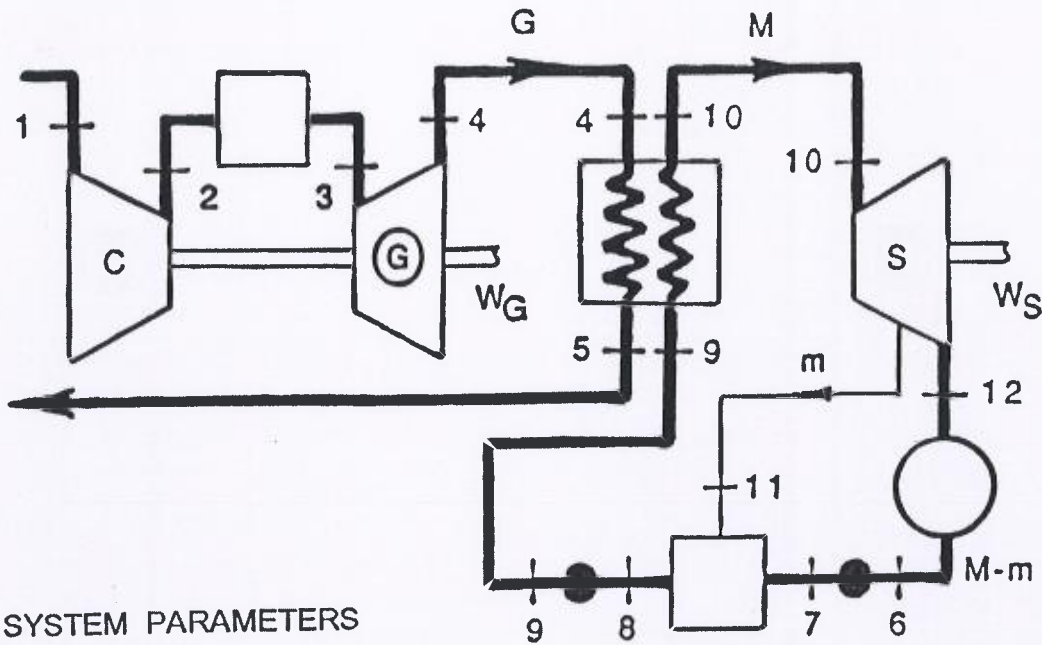

SYSTEM PARAMETERS

Point	Pressure (MPa)	Temperature (°C)	Enthalpy (kJ/kg)
1	0.1	30	
2S	1.2	344	
2	1.2	422	
3	1.2	1000	
4S	0.1	353	
4	0.1	418	
5	0.1	159	
6	0.005	33	136
7	0.4	33	136
8	0.4	144	605
9	5.0	144	610
10	5.0	400	3196
11S	0.4	144	2634
11	0.4	144	2719
12SS	0.005	33	
12S	0.005	33	2025
12	0.005	33	2201

Note that s represents isentropic conditions.

EXAMINATION PAPER ATTACHMENTS

QUESTION 3 NANTICOKE GENERATING STATION

The data below is taken from the technical specifications for Nanticoke Generating Station:

Location On the north shore of Lake Erie in the City of Nanticoke, Ontario, 13 kilometers east of Port Dover.

Boiler

Steam Generator Manufacturer	Babcock & Wilcox Canada Ltd.
Type	Natural Circulation Radiant Boiler
Design Steam Output	453.6 kg/s (3 600 000 lb/hr)
Superheater outlet pressure	16.9 MPa (169 bar) (2 450 lbf/in ²)
Superheater outlet temperature	538°C (1000°F)
Reheat steam pressure	4.0 MPa (40 bar)
Reheat inlet steam temperature	343°C (650°F)
Reheat outlet steam temperature	538°C (1000°F)
Coal consumption at full load	47.9 kg/s (190 ton/hr)
Coal calorific value	30 240 kJ/kg (13 000 Btu/lb)
Number of pulverizers	5 per unit
Economiser inlet water pressure	17.5 MPa (175 bar)
Economiser inlet water temperature	252.5° C (487° F)
Water temperature in steam drum	359.6°C (680°F)

Turbine


Manufacturer	C.A. Parsons and Company Ltd.
Type	Tandem Compound, Impulse Reaction, One Single Flow HP, One Double Flow IP, Two Double Flow LP Condensing.
Speed	3 600 rpm

Generator

Rating	500 000 kW
--------	------------

QUESTION 3 MOLLIER CHART

NAME

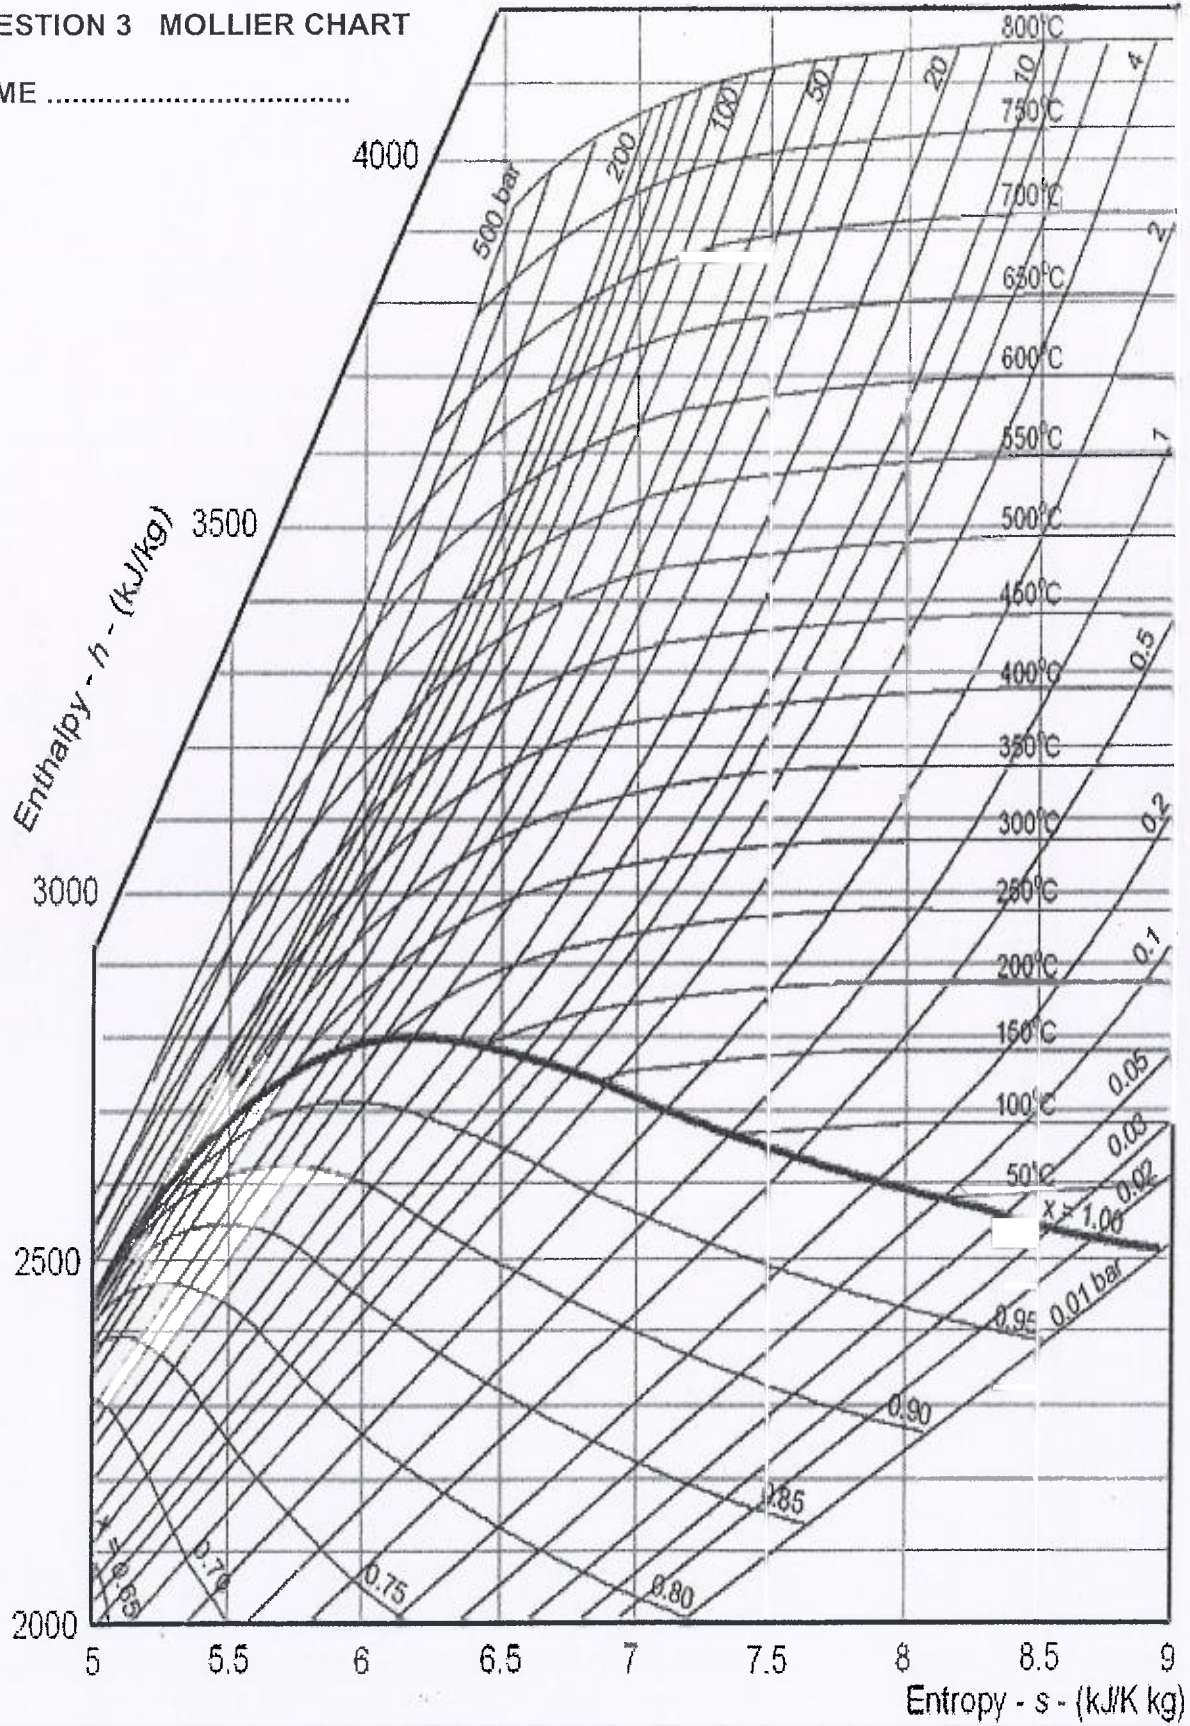

NAME

QUESTION 4 PART II COOLING TOWER EVAPORATION LOSS

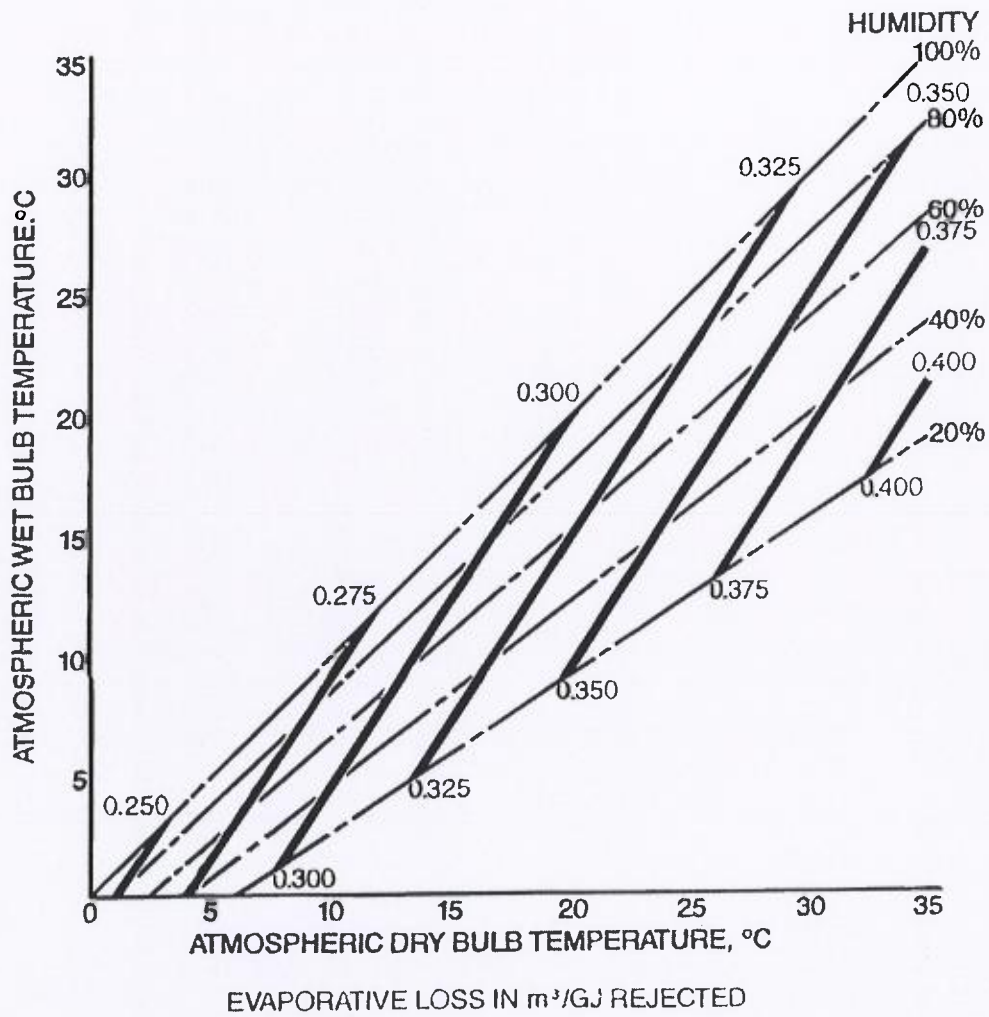


FIG. 7.138 Evaporative loss from natural draught cooling towers
The chart is used to estimate the evaporative loss in m³/GJ of heat rejected.

NOMENCLATURE FOR REFERENCE EQUATIONS (SI UNITS)

A	Flow area, Surface area	m^2
c_p	Specific heat at constant pressure	$J/kg^\circ C$
c_v	Specific heat at constant volume	$J/kg^\circ C$
D	Diameter	m
E	Energy	J
g	Gravitational acceleration	m/s^2
h	Specific enthalpy	J/kg
k	Ratio of specific heats	
L	Length	m
m	Fractional mass flow rate	
m	Mass	kg
M	Mass flow rate	kg/s
p	Pressure	Pa (N/m^2)
q	Heat transferred	J/kg
Q	Heat	J
Q	Volume flow rate	m^3/s
R	Specific gas constant	$J/kg K$
s	Entropy	$J/kg K$
T	Temperature	K
u	Specific internal energy	J/kg
U	Overall heat transfer coefficient	$W/m^2^\circ C$ ($J/sm^2^\circ C$)
v	Specific volume	m^3/kg
V	Velocity	m/s
w	Specific work	J/kg
W	Work	J
x	Length	m
z	Elevation	m
η	Efficiency	
θ	Nozzle angle	$^\circ$
θ	Temperature difference between fluids	$^\circ C$
μ	Dynamic viscosity	Ns/m^2
ν	Kinematic viscosity	m^2/s
ρ	Density	kg/m^3
τ	Thrust	N
Ω	Heat transfer rate	J/s

GENERAL CONSTANTS

Acceleration due to gravity: $g = 9.81 \text{ m/s}^2$	Specific heat of air: $c_p = 1.005 \text{ kJ/kg}^\circ\text{C}$
Atmospheric pressure: $p_{\text{atm}} = 100 \text{ kPa}$	Specific heat of air: $c_v = 0.718 \text{ kJ/kg}^\circ\text{C}$
Density of water: $\rho_{\text{water}} = 1000 \text{ kg/m}^3$	Specific heat of helium: $c_p = 5.193 \text{ kJ/kg}^\circ\text{C}$
Specific heat of water: $c_p = 4.190 \text{ kJ/kg}^\circ\text{C}$	Specific heat of helium: $c_v = 3.117 \text{ kJ/kg}^\circ\text{C}$

THERMODYNAMICS REFERENCE EQUATIONS**Basic Thermodynamics**

First Law:	$dE = \delta Q - \delta W$
Enthalpy:	$h = u + pv$
Continuity:	$\rho VA = \text{constant}$
Flow Work:	$w = \Delta(pv)$
Energy Equation:	$zg + V^2/2 + u + pv + \Delta w + \Delta q = \text{constant}$
Entropy:	$\Delta s = \sum \delta q / T$ (reversible conditions)

Ideal Gas Relationships

Gas Law:	$pv = RT$
Specific Heat at Constant Pressure:	$c_p = \Delta h / \Delta T$
Specific Heat at Constant Volume:	$c_v = \Delta u / \Delta T$
Gas Constant:	$R = c_p - c_v$
Specific Heat Ratio:	$k = c_p / c_v$
Isentropic Relations:	$p_1 / p_2 = (v_2 / v_1)^k = (T_1 / T_2)^{k/(k-1)}$

FLUID MECHANICS REFERENCE EQUATIONS

Fluid Mechanics

Continuity Equation: $\rho_1 V_1 A_1 = \rho_2 V_2 A_2 = M$

Bernoulli's Equation: $p_1/\rho g + z_1 + V_1^2/2g = p_2/\rho g + z_2 + V_2^2/2g$

Momentum Equation: $F = p_1 A_1 - p_2 A_2 - \rho V A (V_2 - V_1)$ (one dimensional)

Steam Turbines

Nozzle Equation: $h_1 - h_2 = (V_2^2 - V_1^2) / 2$

Work: $W = [(V_{1\text{ absolute}}^2 - V_{2\text{ absolute}}^2) + (V_{2\text{ relative}}^2 - V_{1\text{ relative}}^2)] / 2$

Gas Turbines

State Equation: $p v = R T$

Isentropic Equation: $(T_2/T_1) = (p_2/p_1)^{(k-1)/k}$

Enthalpy Change: $h_1 - h_2 = c_p (T_1 - T_2)$ (ideal gas)

Nozzle Equation: $h_1 - h_2 = (V_2^2 - V_1^2) / 2$

Jet Propulsion

Thrust: $\tau = M(V_{\text{jet}} - V_{\text{aircraft}})$

Thrust Power: $\tau V_{\text{aircraft}} = M(V_{\text{jet}} - V_{\text{aircraft}}) V_{\text{aircraft}}$

Jet Power: $P = M(V_{\text{jet}}^2 - V_{\text{aircraft}}^2) / 2$

Propulsion Efficiency: $\eta_p = 2V_{\text{aircraft}} / (V_{\text{jet}} + V_{\text{aircraft}})$

Wind Turbine

Maximum Ideal Power: $P_{\text{max}} = 8 \rho A V_1^3 / 27$

HEAT EXCHANGER REFERENCE EQUATIONS

Heat transferred between fluids

$$\Omega = U A \theta$$

Heat gained or lost by fluids

$$\Omega = M \Delta h$$

$$\Omega = M c_p \Delta T$$

$$\Omega = \rho Q \Delta T$$

NUCLEAR REFERENCE EQUATIONS

Number of nuclei per gram of material

$$N = N_A / M$$

Number of fissile nuclei per cm³ of material

$$N_f = \gamma (N_A / M) \rho$$

Heat release rate in nuclear fuel

$$q^* = \phi N_f \sigma_f E_f$$

Nomenclature

N = number of nuclei (number/g)

N_A = Avogadro's Number

M = molecular weight

γ = fuel enrichment

ρ = density (g/cm³)

q^* = heat release rate (J/cm³)

ϕ = neutron flux (neutrons/cm²s)

N_f = number of fissile nuclei (number/cm³)

σ_f = cross section (barn) (1 barn = 10⁻²⁴ cm²)

E_f = energy release per fission of one atom

Avogadro's Number

$$N_A = 0.602 \times 10^{24} \text{ atoms/mole}$$

Thermodynamics and Heat Power

SIXTH EDITION

Irving Granet, P.E.

late, Queensborough Community College of City University of New York

Maurice Bluestein, Ph.D.

Indiana University—Purdue University, Indianapolis

PRENTICE HALL

Upper Saddle River, New Jersey Columbus, Ohio

TABLE A.1 (SI)
Saturation: Temperature (Steam)

Temp. °C <i>T</i>	Press. kPa <i>P</i>	Specific Volume (m ³ /kg)		Internal Energy (kJ/kg)				Enthalpy (kJ/kg)				Entropy (kJ/kg · °K)			
		Sat. Liquid <i>v_f</i>	Sat. Vapor <i>v_g</i>	Sat. Liquid <i>u_f</i>	Evap. <i>u_{fg}</i>	Sat. Vapor <i>u_g</i>	Sat. Liquid <i>h_f</i>	Evap. <i>h_{fg}</i>	Sat. Vapor <i>h_g</i>	Sat. Liquid <i>s_f</i>	Evap. <i>s_{fg}</i>	Sat. Vapor <i>s_g</i>			
0.01	0.6113	0.001 000	206.14	.00	2375.3	2375.3	.01	2501.3	2501.4	.0000	9.1562	9.1562	9.1562		
5	0.8721	0.001 000	147.12	20.97	2361.3	2382.3	20.98	2489.6	2510.6	.0761	8.9496	9.0257	9.0257		
10	1.2276	0.001 000	106.38	42.00	2347.2	2389.2	42.01	2477.7	2519.8	.1510	8.7498	8.9008	8.9008		
15	1.7051	0.001 001	77.93	62.99	2333.1	2396.1	62.99	2465.9	2528.9	.2245	8.5569	8.7814	8.7814		
20	2.339	0.001 002	57.79	83.95	2319.0	2402.9	83.96	2454.1	2538.1	.2966	8.3706	8.6672	8.6672		
25	3.169	0.001 003	43.36	104.88	2304.9	2409.8	104.89	2442.3	2547.2	.3674	8.1905	8.5580	8.5580		
30	4.246	0.001 004	32.89	125.78	2290.8	2416.6	125.79	2430.5	2556.3	.4369	8.0164	8.4533	8.4533		
35	5.628	0.001 006	25.22	146.67	2276.7	2423.4	146.68	2418.6	2565.3	.5053	7.8478	8.3531	8.3531		
40	7.384	0.001 008	19.52	167.56	2262.6	2430.1	167.57	2406.7	2574.3	.5725	7.6845	8.2570	8.2570		
45	9.593	0.001 010	15.26	188.44	2248.4	2436.8	188.45	2394.8	2583.2	.6387	7.5261	8.1648	8.1648		
50	12.349	0.001 012	12.03	209.32	2234.2	2443.5	209.33	2382.7	2592.1	.7038	7.3725	8.0763	8.0763		
55	15.758	0.001 015	9.568	230.21	2219.9	2450.1	230.23	2370.7	2600.9	.7679	7.2234	7.9913	7.9913		
60	19.940	0.001 017	7.671	251.11	2205.5	2456.6	251.13	2358.5	2609.6	.8312	7.0784	7.9096	7.9096		
65	25.03	0.001 020	6.197	272.02	2191.1	2463.1	272.06	2346.2	2618.3	.8935	6.9375	7.8310	7.8310		
70	31.19	0.001 023	5.042	292.95	2176.6	2469.6	292.98	2333.8	2626.8	.9549	6.8004	7.7553	7.7553		
75	38.58	0.001 026	4.131	313.90	2162.0	2475.9	313.93	2321.4	2635.3	1.0155	6.6669	7.6824	7.6824		
80	47.39	0.001 029	3.407	334.86	2147.4	2482.2	334.91	2308.8	2643.7	1.0753	6.5369	7.6122	7.6122		
85	57.83	0.001 033	2.828	355.84	2132.6	2488.4	355.90	2296.0	2651.9	1.1343	6.4102	7.5445	7.5445		
90	70.14	0.001 036	2.361	376.85	2117.7	2494.5	376.92	2283.2	2660.1	1.1925	6.2866	7.4791	7.4791		
95	84.55	0.001 040	1.982	397.88	2102.7	2500.6	397.96	2270.2	2668.1	1.2500	6.1659	7.4159	7.4159		

TABLE A.1 (SI) (cont'd.)

Temp. °C <i>T</i>	Press. MPa <i>P</i>	Specific Volume (m^3/kg)						Internal Energy (kJ/kg)						Enthalpy (kJ/kg)						Entropy ($kJ/kg \cdot ^\circ K$)					
		Sat. Liquid v_f	Sat. Vapor v_g	Sat. Liquid u_f	Sat. Vapor u_g	Evap. u_{fg}	Sat. Vapor u_g	Sat. Liquid h_f	Sat. Vapor h_g	Evap. h_{fg}	Sat. Vapor h_g	Sat. Liquid s_f	Sat. Vapor s_g	Evap. s_{fg}	Sat. Vapor s_g										
250	3.973	0.001 251	0.050 13	1080.39	1522.0	2602.4	1085.36	1716.2	2801.5	2.7927	3.2802	6.0730													
255	4.319	0.001 263	0.045 98	1104.28	1496.7	2600.9	1109.73	1689.8	2799.5	2.8383	3.1992	6.0375													
260	4.688	0.001 276	0.042 21	1128.39	1470.6	2599.0	1134.37	1662.5	2796.9	2.8838	3.1181	6.0019													
265	5.081	0.001 289	0.038 77	1152.74	1443.9	2596.6	1159.28	1634.4	2793.6	2.9294	3.0368	5.9662													
270	5.499	0.001 302	0.035 64	1177.36	1416.3	2593.7	1184.51	1605.2	2789.7	2.9751	2.9551	5.9301													
275	5.942	0.001 317	0.032 79	1202.25	1387.9	2590.2	1210.07	1574.9	2785.0	3.0208	2.8730	5.8938													
280	6.412	0.001 332	0.030 17	1227.46	1358.7	2586.1	1235.99	1543.6	2779.6	3.0668	2.7903	5.8571													
285	6.909	0.001 348	0.027 77	1253.00	1328.4	2581.4	1262.31	1511.0	2773.3	3.1130	2.7070	5.8199													
290	7.436	0.001 366	0.025 57	1278.92	1297.1	2576.0	1289.07	1477.1	2766.2	3.1594	2.6227	5.7821													
295	7.993	0.001 384	0.023 54	1305.2	1264.7	2569.9	1316.3	1441.8	2758.1	3.2062	2.5375	5.7437													
300	8.581	0.001 404	0.021 67	1332.0	1231.0	2563.0	1344.0	1404.9	2749.0	3.2534	2.4511	5.7045													
305	9.202	0.001 425	0.019 948	1359.3	1195.9	2555.2	1372.4	1366.4	2738.7	3.3010	2.3633	5.6643													
310	9.856	0.001 447	0.018 350	1387.1	1159.4	2546.4	1401.3	1326.0	2727.3	3.3493	2.2737	5.6230													
315	10.547	0.001 472	0.016 867	1415.5	1121.1	2536.6	1431.0	1283.5	2714.5	3.3982	2.1821	5.5804													
320	11.274	0.001 499	0.015 488	1444.6	1080.9	2525.5	1461.5	1238.6	2700.1	3.4480	2.0882	5.5362													
330	12.845	0.001 561	0.012 996	1505.3	993.7	2498.9	1525.3	1140.6	2665.9	3.5507	1.8909	5.4417													
340	14.586	0.001 638	0.010 797	1570.3	894.3	2464.6	1594.2	1027.9	2622.0	3.6594	1.6763	5.3357													
350	16.513	0.001 740	0.008 813	1641.9	776.6	2418.4	1670.6	893.4	2563.9	3.7777	1.4335	5.2112													
360	18.651	0.001 893	0.006 945	1725.2	626.3	2351.5	1760.5	720.5	2481.0	3.9147	1.1379	5.0526													
370	21.03	0.002 213	0.004 925	1844.0	384.5	2228.5	1890.5	441.6	2332.1	4.1106	.6865	4.7971													
374.14	22.09	0.003 155	0.003 155	2029.6	0	2029.6	2099.3	0	2099.3	4.4298	0	4.4298													

TABLE A.2 (SI)

Saturation Pressures (Steam)

Press. kPa <i>P</i>	Temp. °C <i>T</i>	Specific Volume (m ³ /kg)		Internal Energy (kJ/kg)		Enthalpy (kJ/kg)		Entropy (kJ/kg · °K)				
		Sat. Liquid <i>v_f</i>	Sat. Vapor <i>v_g</i>	Sat. Liquid <i>u_f</i>	Evap. <i>u_{fg}</i>	Sat. Vapor <i>u_g</i>	Sat. Liquid <i>h_f</i>	Evap. <i>h_{fg}</i>	Sat. Vapor <i>h_g</i>	Sat. Liquid <i>s_f</i>	Evap. <i>s_{fg}</i>	Sat. Vapor <i>s_g</i>
0.6113	0.01	0.001 000	206.14	.00	2375.3	2375.3	.01	2501.3	2501.4	.0000	9.1562	9.1562
1.0	6.98	0.001 000	129.21	29.30	2355.7	2385.0	29.30	2484.9	2514.2	.1059	8.8697	8.9756
1.5	13.03	0.001 001	87.98	54.71	2338.6	2393.3	54.71	2470.6	2525.3	.1957	8.6322	8.8279
2.0	17.50	0.001 001	67.00	73.48	2326.0	2399.5	73.48	2460.0	2533.5	.2607	8.4629	8.7237
2.5	21.08	0.001 002	54.25	88.48	2315.9	2404.4	88.49	2451.6	2540.0	.3120	8.3311	8.6432
3.0	24.08	0.001 003	45.67	101.04	2307.5	2408.5	101.05	2444.5	2545.5	.3545	8.2291	8.5776
4.0	28.96	0.001 004	34.80	121.45	2293.7	2415.2	121.46	2432.9	2554.4	.4226	8.0520	8.4746
5.0	32.88	0.001 005	28.19	137.81	2282.7	2420.5	137.82	2423.7	2561.5	.4764	7.9187	8.3951
7.5	40.29	0.001 008	19.24	168.78	2261.7	2430.5	168.79	2406.0	2574.8	.5764	7.6750	8.2515
10	45.81	0.001 010	14.67	191.82	2246.1	2437.9	191.83	2392.8	2584.7	.6493	7.5009	8.1502
15	53.97	0.001 014	10.02	225.92	2222.8	2448.7	225.94	2373.1	2599.1	.7549	7.2536	8.0085
20	60.06	0.001 017	7.649	251.38	2205.4	2456.7	251.40	2358.3	2609.7	.8320	7.0766	7.9085
25	64.97	0.001 020	6.204	271.90	2191.2	2463.1	271.93	2346.3	2618.2	.8931	6.9383	7.8314
30	69.10	0.001 022	5.229	289.20	2179.2	2468.4	289.23	2336.1	2625.3	.9439	6.8247	7.7686
40	75.87	0.001 027	3.993	317.53	2159.5	2477.0	317.58	2319.2	2636.8	1.0259	6.6441	7.6700
50	81.33	0.001 030	3.240	340.44	2143.4	2483.9	340.49	2305.4	2645.9	1.0910	6.5029	7.5939
75	91.78	0.001 037	2.217	384.31	2112.4	2496.7	384.39	2278.6	2663.0	1.2130	6.2434	7.4564
MPa												
0.100	99.63	0.001 043	1.6940	417.36	2088.7	2506.1	417.46	2258.0	2675.5	1.3026	6.0568	7.3594
0.125	105.99	0.001 048	1.3749	444.19	2069.3	2513.5	444.32	2241.0	2685.4	1.3740	5.9104	7.2844
0.150	111.37	0.001 053	1.1593	466.94	2052.7	2519.7	467.11	2226.5	2693.6	1.4336	5.7897	7.2233
0.175	116.06	0.001 057	1.0036	486.80	2038.1	2524.9	486.99	2213.6	2700.6	1.4849	5.6868	7.1717
0.200	120.23	0.001 061	0.8857	504.49	2025.0	2529.5	504.70	2201.9	2706.7	1.5301	5.5970	7.1271
0.225	124.00	0.001 064	0.7933	520.47	2013.1	2533.6	520.72	2191.3	2712.1	1.5706	5.5173	7.0878

TABLE A.2 (SI) (cont'd.)

Press. MPa <i>P</i>	Temp. °C <i>T</i>	Specific Volume				Internal Energy				Enthalpy				Entropy			
		Liquid		Vapor		Liquid		Vapor		Liquid		Vapor		Liquid		Vapor	
		<i>v_f</i>	<i>v_g</i>	<i>u_f</i>	<i>u_g</i>	<i>u_f</i>	<i>u_g</i>	<i>h_f</i>	<i>h_g</i>	<i>h_f</i>	<i>h_g</i>	<i>s_f</i>	<i>s_g</i>				
0.250	127.44	0.001 067	0.7187	535.10	2002.1	2537.2	535.37	2181.5	2716.9	1.6072	5.4455	7.0527					
0.275	130.60	0.001 070	0.6573	548.59	1991.9	2540.5	548.89	2172.4	2721.3	1.6408	5.3801	7.0209					
0.300	133.55	0.001 073	0.6058	561.15	1982.4	2543.6	561.47	2163.8	2725.3	1.6718	5.3201	6.9919					
0.325	136.30	0.001 076	0.5620	572.90	1973.5	2546.4	573.25	2155.8	2729.0	1.7006	5.2646	6.9652					
0.350	138.88	0.001 079	0.5243	583.95	1965.0	2548.9	584.33	2148.1	2732.4	1.7275	5.2130	6.9405					
0.375	141.32	0.001 081	0.4914	594.40	1956.9	2551.3	594.81	2140.8	2735.6	1.7528	5.1647	6.9175					
0.40	143.63	0.001 084	0.4625	604.31	1949.3	2553.6	604.74	2133.8	2738.6	1.7766	5.1193	6.8959					
0.45	147.93	0.001 088	0.4140	622.77	1934.9	2557.6	623.25	2120.7	2743.9	1.8207	5.0359	6.8565					
0.50	151.86	0.001 093	0.3749	639.68	1921.6	2561.2	640.23	2108.5	2748.7	1.8607	4.9606	6.8213					
0.55	155.48	0.001 097	0.3427	655.32	1909.2	2564.5	655.93	2097.0	2753.0	1.8973	4.8920	6.7893					
0.60	158.85	0.001 101	0.3157	669.90	1897.5	2567.4	670.56	2086.3	2756.8	1.9312	4.8288	6.7600					
0.65	162.01	0.001 104	0.2927	683.56	1886.5	2570.1	684.28	2076.0	2760.3	1.9627	4.7703	6.7331					
0.70	164.97	0.001 108	0.2729	696.44	1876.1	2572.5	697.22	2066.3	2763.5	1.9922	4.7158	6.7080					
0.75	167.78	0.001 112	0.2556	708.64	1866.1	2574.7	709.47	2057.0	2766.4	2.0200	4.6647	6.6847					
0.80	170.43	0.001 115	0.2404	720.22	1856.6	2576.8	721.11	2048.0	2769.1	2.0462	4.6166	6.6628					
0.85	172.96	0.001 118	0.2270	731.27	1847.4	2578.7	732.22	2039.4	2771.6	2.0710	4.5711	6.6421					
0.90	175.38	0.001 121	0.2150	741.83	1838.6	2580.5	742.83	2031.1	2773.9	2.0946	4.5280	6.6226					
0.95	177.69	0.001 124	0.2042	751.95	1830.2	2582.1	753.02	2023.1	2776.1	2.1172	4.4869	6.6041					
1.00	179.91	0.001 127	0.194 44	761.68	1822.0	2583.6	762.81	2015.3	2778.1	2.1387	4.4478	6.5865					
1.10	184.09	0.001 133	0.177 53	780.09	1806.3	2586.4	781.34	2000.4	2781.7	2.1792	4.3744	6.5536					
1.20	187.99	0.001 139	0.163 33	797.29	1791.5	2588.8	798.65	1986.2	2784.8	2.2166	4.3067	6.5233					
1.30	191.64	0.001 144	0.151 25	813.44	1777.5	2591.0	814.93	1972.7	2787.6	2.2515	4.2438	6.4953					
1.40	195.07	0.001 149	0.140 84	828.70	1764.1	2592.8	830.30	1959.7	2790.0	2.2842	4.1850	6.4693					

TABLE A.2 (SI) (cont'd.)

Press. MPa <i>P</i>	Temp. °C <i>T</i>	Specific Volume (m ³ /kg)			Internal Energy (kJ/kg)			Enthalpy (kJ/kg)			Entropy (kJ/kg·°K)		
		Sat. Liquid <i>v_f</i>	Sat. Vapor <i>v_g</i>	Sat. Vapor <i>v_g</i>	Sat. Liquid <i>u_f</i>	Evap. <i>u_{fg}</i>	Sat. Vapor <i>u_g</i>	Sat. Liquid <i>h_f</i>	Evap. <i>h_{fg}</i>	Sat. Vapor <i>h_g</i>	Sat. Liquid <i>s_f</i>	Evap. <i>s_{fg}</i>	Sat. Vapor <i>s_g</i>
1.50	198.32	0.001 154	0.131 77	0.131 77	843.16	1751.3	2594.5	844.89	1947.3	2792.2	2.3150	4.1298	6.4448
1.75	205.76	0.001 166	0.113 49	0.113 49	876.46	1721.4	2597.8	878.50	1917.9	2796.4	2.3851	4.0044	6.3896
2.00	212.42	0.001 177	0.099 63	0.099 63	906.44	1693.8	2600.3	908.79	1890.7	2799.5	2.4474	3.8935	6.3409
2.25	218.45	0.001 187	0.088 75	0.088 75	933.83	1668.2	2602.0	936.49	1865.2	2801.7	2.5085	3.7937	6.2972
2.5	223.99	0.001 197	0.079 98	0.079 98	959.11	1644.0	2603.1	962.11	1841.0	2803.1	2.5547	3.7028	6.2575
3.0	233.90	0.001 217	0.066 68	0.066 68	1004.78	1599.3	2604.1	1008.42	1795.7	2804.2	2.6457	3.5412	6.1869
3.5	242.60	0.001 235	0.057 07	0.057 07	1045.43	1558.3	2603.7	1049.75	1753.7	2803.4	2.7253	3.4000	6.1253
4	250.40	0.001 252	0.049 78	0.049 78	1082.31	1520.0	2602.3	1087.31	1714.1	2801.4	2.7964	3.2737	6.0701
5	263.99	0.001 286	0.039 44	0.039 44	1147.81	1449.3	2597.1	1154.23	1640.1	2794.3	2.9202	3.0532	5.9734
6	275.64	0.001 319	0.032 44	0.032 44	1205.44	1384.3	2589.7	1213.35	1571.0	2784.3	3.0267	2.8625	5.8892
7	285.88	0.001 351	0.027 37	0.027 37	1257.55	1323.0	2580.5	1267.00	1505.1	2772.1	3.1211	2.6922	5.8133
8	295.06	0.001 384	0.023 52	0.023 52	1305.57	1264.2	2569.8	1316.64	1441.3	2758.0	3.2068	2.5364	5.7432
9	303.40	0.001 418	0.020 48	0.020 48	1350.51	1207.3	2557.8	1363.26	1378.9	2742.1	3.2858	2.3915	5.6772
10	311.06	0.001 452	0.018 026	0.018 026	1393.04	1151.4	2544.4	1407.56	1317.1	2724.7	3.3596	2.2544	5.6141
11	318.15	0.001 489	0.015 987	0.015 987	1433.7	1096.0	2529.8	1450.1	1255.5	2705.6	3.4295	2.1233	5.5527
12	324.75	0.001 527	0.014 263	0.014 263	1473.0	1040.7	2513.7	1491.3	1193.6	2684.9	3.4962	1.9962	5.4924
13	330.93	0.001 567	0.012 780	0.012 780	1511.1	985.0	2496.1	1531.5	1130.7	2662.2	3.5606	1.8718	5.4323
14	336.75	0.001 611	0.011 485	0.011 485	1548.6	928.2	2476.8	1571.1	1066.5	2637.6	3.6232	1.7485	5.3717
15	342.24	0.001 658	0.010 337	0.010 337	1585.6	869.8	2455.5	1610.5	1000.0	2610.5	3.6848	1.6249	5.3098
16	347.44	0.001 711	0.009 306	0.009 306	1622.7	809.0	2431.7	1650.1	930.6	2580.6	3.7461	1.4994	5.2455
17	352.37	0.001 770	0.008 364	0.008 364	1660.2	744.8	2405.0	1690.3	856.9	2547.2	3.8079	1.3698	5.1777
18	357.06	0.001 840	0.007 489	0.007 489	1698.9	675.4	2374.3	1732.0	777.1	2509.1	3.8715	1.2329	5.1044
19	361.54	0.001 924	0.006 657	0.006 657	1739.9	598.1	2338.1	1776.5	688.0	2464.5	3.9388	1.0839	5.0228
20	365.81	0.002 036	0.005 834	0.005 834	1785.6	507.5	2293.0	1826.3	583.4	2409.7	4.0139	.9130	4.9269
21	369.89	0.002 207	0.004 952	0.004 952	1842.1	388.5	2230.6	1888.4	446.2	2334.6	4.1075	.6938	4.8013
22	373.80	0.002 742	0.003 568	0.003 568	1961.9	125.2	2087.1	2022.2	143.4	2165.6	4.3110	.2216	4.5327
22.09	374.14	0.003 155	0.003 155	0.003 155	2029.6	0	2029.6	2099.3	0	2099.3	4.4298	0	4.4298

TABLE A.3 (SI)
Properties of Superheated Steam

T	P = .010 MPa (45.81)					P = .050 MPa (81.33)					P = .10 MPa (99.63)				
	v	u	h	s	s	v	u	h	s	s	v	u	h	s	s
Sat.	14.674	2437.9	2584.7	8.1502	3.240	2483.9	2645.9	7.5939	1.6940	2506.1	2675.5	7.3594			
50	14.869	2443.9	2592.6	8.1749	3.418	2511.6	2682.5	7.6947	1.6958	2506.7	2676.2	7.3614			
100	17.196	2515.5	2687.5	8.4479	3.889	2585.6	2780.1	7.9401	1.9364	2582.8	2776.4	7.6134			
150	19.512	2587.9	2783.0	8.6882	4.356	2659.9	2877.7	8.1580	2.172	2658.1	2875.3	7.8343			
200	21.825	2661.3	2879.5	8.9038	4.820	2735.0	2976.0	8.3556	2.406	2733.7	2974.3	8.0333			
250	24.136	2736.0	2977.3	9.1002	5.284	2811.3	3075.5	8.5373	2.639	2810.4	3074.3	8.2158			
300	26.445	2812.1	3076.5	9.2813	6.209	2968.5	3278.9	8.8642	3.103	2967.9	3278.2	8.5435			
400	31.063	2968.9	3279.6	9.6077	7.134	3132.0	3488.7	9.1546	3.565	3131.6	3488.1	8.8342			
500	35.679	3132.3	3489.1	9.8978	8.057	3302.2	3705.1	9.4178	4.028	3301.9	3704.7	9.0976			
600	40.295	3302.5	3705.4	10.1608	8.981	3479.4	3928.5	9.6599	4.490	3479.2	3928.2	9.3398			
700	44.911	3479.6	3928.7	10.4028	9.904	3663.6	4158.9	9.8852	4.952	3663.5	4158.6	9.5652			
800	49.526	3663.8	4159.0	10.6281	10.828	3854.9	4396.3	10.0967	5.414	3854.8	4396.1	9.7767			
900	54.141	3855.0	4396.4	10.8396	11.751	4052.9	4640.5	10.2964	5.875	4052.8	4640.3	9.9764			
1000	58.757	4053.0	4640.6	11.0393	12.674	4257.4	4891.1	10.4859	6.337	4257.3	4891.0	10.1659			
1100	63.372	4257.5	4891.2	11.2287	13.597	4467.8	5147.7	10.6662	6.799	4467.7	5147.6	10.3463			
1200	67.987	4467.9	5147.8	11.4091	14.521	4683.6	5409.6	10.8382	7.260	4683.5	5409.5	10.5183			
1300	72.602	4683.7	5409.7	11.5811											
					P = .30 MPa (133.55)					P = .40 MPa (143.63)					
					v	u	h	s	s	v	u	h	s	s	
Sat.	.8857	2529.5	2706.7	7.1272	.6058	2543.6	2725.3	6.9919	.4625	2553.6	2738.6	6.8959			
150	.9596	2576.9	2768.8	7.2795	.6339	2570.8	2761.0	7.0778	.4708	2564.5	2752.8	6.9299			
200	1.0803	2654.4	2870.5	7.5066	.7163	2650.7	2865.6	7.3115	.5342	2646.8	2860.5	7.1706			
250	1.1988	2731.2	2971.0	7.7086	.7964	2728.7	2967.6	7.5166	.5951	2726.1	2964.2	7.3789			
300	1.3162	2808.6	3071.8	7.8926	.8753	2806.7	3069.3	7.7022	.6548	2804.8	3066.8	7.5662			
400	1.5493	2966.7	3276.6	8.2218	1.0315	2965.6	3275.0	8.0330	.7726	2964.4	3273.4	7.8985			

TABLE A.3 (SI) (cont'd.)

<i>T</i>	<i>P</i> = 1.00 MPa (179.91)					<i>P</i> = 1.20 MPa (187.99)					<i>P</i> = 1.40 MPa (195.07)							
	<i>v</i>	<i>u</i>	<i>h</i>	<i>s</i>	<i>s</i>	<i>v</i>	<i>u</i>	<i>h</i>	<i>s</i>	<i>s</i>	<i>v</i>	<i>u</i>	<i>h</i>	<i>s</i>	<i>v</i>	<i>u</i>	<i>h</i>	<i>s</i>
Sat.	.194 44	2583.6	2778.1	6.5865		.163 33	2588.8	2784.8	6.5233		.140 84	2592.8	2790.0	6.4693				
200	.2060	2621.9	2827.9	6.6940		.169 30	2612.8	2815.9	6.5898		.143 02	2603.1	2803.3	6.4975				
250	.2327	2709.9	2942.6	6.9247		.192 34	2704.2	2935.0	6.8294		.163 50	2698.3	2927.2	6.7467				
300	.2579	2793.2	3051.2	7.1229		.2138	2789.2	3045.8	7.0317		.182 28	2785.2	3040.4	6.9534				
350	.2825	2875.2	3157.7	7.3011		.2345	2872.2	3153.6	7.2121		.2003	2869.2	3149.5	7.1360				
400	.3066	2957.3	3263.9	7.4651		.2548	2954.9	3260.7	7.3774		.2178	2952.5	3257.5	7.3026				
500	.3541	3124.4	3478.5	7.7622		.2946	3122.8	3476.3	7.6759		.2521	3121.1	3474.1	7.6027				
600	.4011	3296.8	3697.9	8.0290		.3339	3295.6	3696.3	7.9435		.2860	3294.4	3694.8	7.8710				
700	.4478	3475.3	3923.1	8.2731		.3729	3474.4	3922.0	8.1881		.3195	3473.6	3920.8	8.1160				
800	.4943	3660.4	4154.7	8.4996		.4118	3659.7	4153.8	8.4148		.3528	3659.0	4153.0	8.3431				
900	.5407	3852.2	4392.9	8.7118		.4505	3851.6	4392.2	8.6272		.3861	3851.1	4391.5	8.5556				
1000	.5871	4050.5	4637.6	8.9119		.4892	4050.0	4637.0	8.8274		.4192	4049.5	4636.4	8.7559				
1100	.6335	4255.1	4888.6	9.1017		.5278	4254.6	4888.0	9.0172		.4524	4254.1	4887.5	8.9457				
1200	.6798	4465.6	5145.4	9.2822		.5665	4465.1	5144.9	9.1977		.4855	4464.7	5144.4	9.1262				
1300	.7261	4681.3	5407.4	9.4543		.6051	4680.9	5407.0	9.3698		.5186	4680.4	5406.5	9.2984				

<i>T</i>	<i>P</i> = 1.60 MPa (201.41)					<i>P</i> = 1.80 MPa (207.15)					<i>P</i> = 2.00 MPa (212.42)							
	<i>v</i>	<i>u</i>	<i>h</i>	<i>s</i>	<i>s</i>	<i>v</i>	<i>u</i>	<i>h</i>	<i>s</i>	<i>s</i>	<i>v</i>	<i>u</i>	<i>h</i>	<i>s</i>	<i>v</i>	<i>u</i>	<i>h</i>	<i>s</i>
Sat.	.123 80	2596.0	2794.0	6.4218		.110 42	2598.4	2797.1	6.3794		.099 63	2600.3	2799.5	6.3409				
225	.132 87	2644.7	2857.3	6.5518		.116 73	2636.6	2846.7	6.4808		.103 77	2628.3	2835.8	6.4147				
250	.141 84	2692.3	2919.2	6.6732		.124 97	2686.0	2911.0	6.6066		.111 44	2679.6	2902.5	6.5453				
300	.158 62	2781.1	3034.8	6.8844		.140 21	2776.9	3029.2	6.8226		.125 47	2772.6	3023.5	6.7664				
350	.174 56	2866.1	3145.4	7.0694		.154 57	2863.0	3141.2	7.0100		.138 57	2859.8	3137.0	6.9563				
400	.190 05	2950.1	3254.2	7.2374		.168 47	2947.7	3250.9	7.1794		.151 20	2945.2	3247.6	7.1271				
500	.2203	3119.5	3472.0	7.5390		.195 50	3117.9	3469.8	7.4825		.175 68	3116.2	3467.6	7.4317				
600	.2500	3293.3	3693.2	7.8080		.2220	3292.1	3691.7	7.7523		.199 60	3290.9	3690.1	7.7024				
700	.2794	3472.7	3919.7	8.0535		.2482	3471.8	3918.5	7.9983		.2232	3470.9	3917.4	7.9487				

TABLE A.3 (SI) (cont'd.)

T	v	u	h	s	v	u	h	s	v	u	h	s
<div style="display: flex; justify-content: space-around;"> <div style="text-align: center;"> <p>P = 1.60 MPa (201.41)</p> </div> <div style="text-align: center;"> <p>P = 1.80 MPa (207.15)</p> </div> <div style="text-align: center;"> <p>P = 2.00 MPa (212.42)</p> </div> </div>												
800	.3086	3658.3	4152.1	8.2808	.2742	3657.6	4151.2	8.2258	.2467	3657.0	4150.3	8.1765
900	.3377	3850.5	4390.8	8.4935	.3001	3849.9	4390.1	8.4386	.2700	3849.3	4389.4	8.3895
1000	.3668	4049.0	4635.8	8.6938	.3260	4048.5	4635.2	8.6391	.2933	4048.0	4634.6	8.5901
1100	.3958	4253.7	4887.0	8.8837	.3518	4253.2	4886.4	8.8290	.3166	4252.7	4885.9	8.7800
1200	.4248	4464.2	5143.9	9.0643	.3776	4463.7	5143.4	9.0096	.3398	4463.3	5142.9	8.9607
1300	.4538	4679.9	5406.0	9.2364	.4034	4679.5	5405.6	9.1818	.3631	4679.0	5405.1	9.1329
<div style="display: flex; justify-content: space-around;"> <div style="text-align: center;"> <p>P = 2.50 MPa (223.99)</p> </div> <div style="text-align: center;"> <p>P = 3.00 MPa (233.90)</p> </div> <div style="text-align: center;"> <p>P = 3.50 MPa (242.60)</p> </div> </div>												
Sat.	.079 98	2603.1	2803.1	6.2575	.066 68	2604.1	2804.2	6.1869	.057 07	2603.7	2803.4	6.1253
225	.080 27	2605.6	2806.3	6.2639								
250	.087 00	2662.6	2880.1	6.4085	.070 58	2644.0	2855.8	6.2872	.058 72	2623.7	2829.2	6.1749
300	.098 90	2761.6	3008.8	6.6438	.081 14	2750.1	2993.5	6.5390	.068 42	2738.0	2977.5	6.4461
350	.109 76	2851.9	3126.3	6.8403	.090 53	2843.7	3115.3	6.7428	.076 78	2835.3	3104.0	6.6579
400	.120 10	2939.1	3239.3	7.0148	.099 36	2932.8	3230.9	6.9212	.084 53	2926.4	3222.3	6.8405
450	.130 14	3025.5	3350.8	7.1746	.107 87	3020.4	3344.0	7.0834	.091 96	3015.3	3337.2	7.0052
500	.139 98	3112.1	3462.1	7.3234	.116 19	3108.0	3456.5	7.2338	.099 18	3103.0	3450.9	7.1572
600	.159 30	3288.0	3686.3	7.5960	.132 43	3285.0	3682.3	7.5085	.113 24	3282.1	3678.4	7.4339
700	.178 32	3468.7	3914.5	7.8435	.148 38	3466.5	3911.7	7.7571	.126 99	3464.3	3908.8	7.6837
800	.197 16	3655.3	4148.2	8.0720	.164 14	3653.5	4145.9	7.9862	.140 56	3651.8	4143.7	7.9134
900	.215 90	3847.9	4387.6	8.2853	.179 80	3846.5	4385.9	8.1999	.154 02	3845.0	4384.1	8.1276
1000	.2346	4046.7	4633.1	8.4861	.195 41	4045.4	4631.6	8.4009	.167 43	4044.1	4630.1	8.3288
1100	.2532	4251.5	4884.6	8.6762	.210 98	4250.3	4883.3	8.5912	.180 80	4249.2	4881.9	8.5192
1200	.2718	4462.1	5141.7	8.8569	.226 52	4460.9	5140.5	8.7720	.194 15	4459.8	5139.3	8.7000
1300	.2905	4677.8	5404.0	9.0291	.242 06	4676.6	5402.8	8.9442	.207 49	4675.5	5401.7	8.8723

TABLE A.3 (SI) (cont'd.)

T	P = 4.0 MPa (250.40)					P = 4.5 MPa (257.49)					P = 5.0 MPa (263.99)								
	v	u	h	s	s	v	u	h	s	s	v	u	h	s					
Sat.	.049 78	2602.3	2801.4	6.0701		.044 06	2600.1	2798.3	6.0198		.039 44	2597.1	2794.3	5.9734					
275	.054 57	2667.9	2886.2	6.2285		.047 30	2650.3	2863.2	6.1401		.041 41	2631.3	2838.3	6.0544					
300	.058 84	2725.3	2960.7	6.3615		.051 35	2712.0	2943.1	6.2828		.045 32	2698.0	2924.5	6.2084					
350	.066 45	2826.7	3092.5	6.5821		.058 40	2817.8	3080.6	6.5131		.051 94	2808.7	3068.4	6.4493					
400	.073 41	2919.9	3213.6	6.7690		.064 75	2913.3	3204.7	6.7047		.057 81	2906.6	3195.7	6.6459					
450	.080 02	3010.2	3330.3	6.9363		.070 74	3005.0	3323.3	6.8746		.063 30	2999.7	3316.2	6.8186					
500	.086 43	3099.5	3445.3	7.0901		.076 51	3095.3	3439.6	7.0301		.068 57	3091.0	3433.8	6.9759					
600	.098 85	3279.1	3674.4	7.3688		.087 65	3276.0	3670.5	7.3110		.078 69	3273.0	3666.5	7.2589					
700	.110 95	3462.1	3905.9	7.6198		.098 47	3459.9	3903.0	7.5631		.088 49	3457.6	3900.1	7.5122					
800	.122 87	3650.0	4141.5	7.8502		.109 11	3648.3	4139.3	7.7942		.098 11	3646.6	4137.1	7.7440					
900	.134 69	3843.6	4382.3	8.0647		.119 65	3842.2	4380.6	8.0091		.107 62	3840.7	4378.8	7.9593					
1000	.146 45	4042.9	4628.7	8.2562		.130 13	4041.6	4627.2	8.2108		.117 07	4040.4	4625.7	8.1612					
1100	.158 17	4248.0	4880.6	8.4567		.140 56	4246.8	4879.3	8.4015		.126 48	4245.6	4878.0	8.3520					
1200	.169 87	4458.6	5138.1	8.6376		.150 98	4457.5	5136.9	8.5825		.135 87	4456.3	5135.7	8.5331					
1300	.181 56	4674.3	5400.5	8.8100		.161 39	4673.1	5399.4	8.7549		.145 26	4672.0	5398.2	8.7055					
					P = 6.0 MPa (275.64)					P = 7.0 MPa (285.88)					P = 8.0 MPa (295.06)				
					v	u	h	s	s	v	u	h	s	s	v	u	h	s	s
Sat.	.032 44	2589.7	2784.3	5.8892		.027 37	2580.5	2772.1	5.8133		.023 52	2569.8	2758.0	5.7432					
300	.036 16	2667.2	2884.2	6.0674		.029 47	2632.2	2838.4	5.9305		.024 26	2590.9	2785.0	5.7906					
350	.042 93	2789.6	3043.0	6.3335		.035 24	2769.4	3016.0	6.2283		.029 95	2747.7	2987.3	6.1301					
400	.047 39	2892.9	3177.2	6.5408		.039 93	2878.6	3158.1	6.4478		.034 32	2863.8	3138.3	6.3634					
450	.052 14	2988.9	3301.8	6.7193		.044 16	2978.0	3287.1	6.6327		.038 17	2966.7	3272.0	6.5551					
500	.056 65	3082.2	3422.2	6.8803		.048 14	3073.4	3410.3	6.7975		.041 75	3064.3	3398.3	6.7240					
550	.061 01	3174.6	3540.6	7.0288		.051 95	3167.2	3530.9	6.9486		.045 16	3159.8	3521.0	6.8778					
600	.065 25	3266.9	3658.4	7.1677		.055 65	3260.7	3650.3	7.0894		.048 45	3254.4	3642.0	7.0206					

TABLE A.3 (SI) (cont'd.)

T	P = 6.0 MPa (275.64)					P = 7.0 MPa (285.88)					P = 8.0 MPa (295.06)				
	v	u	h	s	s	v	u	h	s	s	v	u	h	s	s
700	.073 52	3453.1	3894.2	7.4234	7.4234	.062 83	3448.5	3888.3	7.3476	7.3476	.054 81	3443.9	3882.4	7.2812	7.2812
800	.081 60	3643.1	4132.7	7.6566	7.6566	.069 81	3639.5	4128.2	7.5822	7.5822	.060 97	3636.0	4123.8	7.5173	7.5173
900	.089 58	3837.8	4375.3	7.8727	7.8727	.076 69	3835.0	4371.8	7.7991	7.7991	.067 02	3832.1	4368.3	7.7351	7.7351
1000	.097 49	4037.8	4622.7	8.0751	8.0751	.083 50	4035.3	4619.8	8.0020	8.0020	.073 01	4032.8	4616.9	7.9384	7.9384
1100	.105 36	4243.3	4875.4	8.2661	8.2661	.090 27	4240.9	4872.8	8.1933	8.1933	.078 96	4238.6	4870.3	8.1300	8.1300
1200	.113 21	4454.0	5133.3	8.4474	8.4474	.097 03	4451.7	5130.9	8.3747	8.3747	.084 89	4449.5	5128.5	8.3115	8.3115
1300	.121 06	4669.6	5396.0	8.6199	8.6199	.103 77	4667.3	5393.7	8.5473	8.5473	.090 80	4665.0	5391.5	8.4842	8.4842
P = 9.0 MPa (303.40)															
Sat.	.020 48	2557.8	2742.1	5.6772	5.6772	.018 026	2544.4	2724.7	5.6141	5.6141	.013 495	2505.1	2673.8	5.4624	5.4624
325	.023 27	2646.6	2856.0	5.8712	5.8712	.019 861	2610.4	2809.1	5.7568	5.7568	.016 126	2624.6	2826.2	5.7118	5.7118
350	.025 80	2724.4	2956.6	6.0361	6.0361	.022 42	2699.2	2923.4	5.9443	5.9443	.020 00	2789.3	3039.3	6.0417	6.0417
400	.029 93	2848.4	3117.8	6.2854	6.2854	.026 41	2832.4	3096.5	6.2120	6.2120	.022 99	2912.5	3199.8	6.2719	6.2719
450	.033 50	2955.2	3256.6	6.4844	6.4844	.029 75	2943.4	3240.9	6.4190	6.4190	.025 60	3021.7	3341.8	6.4618	6.4618
500	.036 77	3055.2	3386.1	6.6576	6.6576	.032 79	3045.8	3373.7	6.5966	6.5966	.028 01	3125.0	3475.2	6.6290	6.6290
550	.039 87	3152.2	3511.0	6.8142	6.8142	.035 64	3144.6	3500.9	6.7561	6.7561	.030 29	3225.4	3604.0	6.7810	6.7810
600	.042 85	3248.1	3633.7	6.9589	6.9589	.038 37	3241.7	3625.3	6.9029	6.9029	.032 48	3324.4	3730.4	6.9218	6.9218
650	.045 74	3343.6	3755.3	7.0943	7.0943	.041 01	3338.2	3748.2	7.0398	7.0398	.034 60	3422.9	3855.3	7.0536	7.0536
700	.048 57	3439.3	3876.5	7.2221	7.2221	.043 58	3434.7	3870.5	7.1687	7.1687	.038 69	3620.0	4103.6	7.2965	7.2965
800	.054 09	3632.5	4119.3	7.4596	7.4596	.048 59	3628.9	4114.8	7.4077	7.4077	.042 67	3819.1	4352.5	7.5182	7.5182
900	.059 50	3829.2	4364.8	7.6783	7.6783	.053 49	3826.3	4361.2	7.6272	7.6272	.046 58	4021.6	4603.8	7.7237	7.7237
1000	.064 85	4030.3	4614.0	7.8821	7.8821	.058 32	4027.8	4611.0	7.8315	7.8315	.050 45	4228.2	4858.8	7.9165	7.9165
1100	.070 16	4236.3	4867.7	8.0740	8.0740	.063 12	4234.0	4865.1	8.0237	8.0237	.054 30	4439.3	5118.0	8.0987	8.0987
1200	.075 44	4447.2	5126.2	8.2556	8.2556	.067 89	4444.9	5123.8	8.2055	8.2055	.058 13	4654.8	5381.4	8.2717	8.2717
1300	.080 72	4662.7	5389.2	8.4284	8.4284	.072 65	4460.5	5387.0	8.3783	8.3783					

TABLE A.3 (SI) (cont'd.)

T	P = 15.0 MPa (342.24)					P = 17.5 MPa (354.75)					P = 20.0 MPa (365.81)									
	v	u	h	s	s	v	u	h	s	s	v	u	h	s	s					
Sat.	.010 337	2455.5	2610.5	5.3098		.007 920	2390.2	2528.8	5.1419		.005 834	2293.0	2409.7	4.9269						
350	.011 470	2520.4	2692.4	5.4421		.012 447	2685.0	2902.9	5.7213		.009 942	2619.3	2818.1	5.5540						
400	.015 649	2740.7	2975.5	5.8811		.015 174	2844.2	3109.7	6.0184		.012 695	2806.2	3060.1	5.9017						
450	.018 445	2879.5	3156.2	6.1404		.017 358	2970.3	3274.1	6.2383		.014 768	2942.9	3238.2	6.1401						
500	.020 80	2996.6	3308.6	6.3443		.019 288	3083.9	3421.4	6.4230		.016 555	3062.4	3393.5	6.3348						
550	.022 93	3104.7	3448.6	6.5199		.021 06	3191.5	3560.1	6.5866		.018 178	3174.0	3537.6	6.5048						
600	.024 91	3208.6	3582.3	6.6776		.022 74	3296.0	3693.9	6.7357		.019 693	3281.4	3675.3	6.6582						
650	.026 80	3310.3	3712.3	6.8224		.024 34	3398.7	3824.6	6.8736		.021 13	3386.4	3809.0	6.7993						
700	.028 61	3410.9	3840.1	6.9572		.027 38	3601.8	4081.1	7.1244		.023 85	3592.7	4069.7	7.0544						
800	.032 10	3610.9	4092.4	7.2040		.030 31	3804.7	4335.1	7.3507		.026 45	3797.5	4326.4	7.2830						
900	.035 46	3811.9	4343.8	7.4279		.033 16	4009.3	4589.5	7.5589		.028 97	4003.1	4582.5	7.4925						
1000	.038 75	4015.4	4596.6	7.6348		.035 97	4216.9	4846.4	7.7531		.031 45	4211.3	4840.2	7.6874						
1100	.042 00	4222.6	4852.6	7.8283		.038 76	4428.3	5106.6	7.9360		.033 91	4422.8	5101.0	7.8707						
1200	.045 23	4433.8	5112.3	8.0108		.041 54	4643.5	5370.5	8.1093		.036 36	4638.0	5365.1	8.0442						
1300	.048 45	4649.1	5376.0	8.1840																
						P = 25.0 MPa					P = 30.0 MPa					P = 35.0 MPa				
375	.001 973 1	1798.7	1848.0	4.0320		.001 789 2	1737.8	1791.5	3.9305		.001 700 3	1702.9	1762.4	3.8722						
400	.006 004	2430.1	2580.2	5.1418		.002 790	2067.4	2151.1	4.4728		.002 100	1914.1	1987.6	4.2126						
425	.007 881	2609.2	2806.3	5.4723		.005 303	2455.1	2614.2	5.1504		.003 428	2253.4	2373.4	4.7747						
450	.009 162	2720.7	2949.7	5.6744		.006 735	2619.3	2821.4	5.4424		.004 961	2498.7	2672.4	5.1962						
500	.011 123	2884.3	3162.4	5.9592		.008 678	2820.7	3081.1	5.7905		.006 927	2751.9	2994.4	5.6282						
550	.012 724	3017.5	3335.6	6.1765		.010 168	2970.3	3275.4	6.0342		.008 345	2921.0	3213.0	5.9026						
600	.014 137	3137.9	3491.4	6.3602		.011 446	3100.5	3443.9	6.2331		.009 527	3062.0	3395.5	6.1179						
650	.015 433	3251.6	3637.4	6.5229		.012 596	3221.0	3598.9	6.4058		.010 575	3189.8	3559.9	6.3010						

TABLE A.3 (SI) (cont'd.)

T	P = 25.0 MPa					P = 30.0 MPa					P = 35.0 MPa					
	v	u	h	s	v	u	h	s	v	u	h	s	v	u	h	s
700	.016 646	3361.3	3777.5	6.6707	.013 661	3335.8	3745.6	6.5606	.011 533	3309.8	3713.5	6.4631				
800	.018 912	3574.3	4047.1	6.9345	.015 623	3555.5	4024.2	6.8332	.013 278	3536.7	4001.5	6.7450				
900	.021 045	3783.0	4309.1	7.1680	.017 448	3768.5	4291.9	7.0718	.014 883	3754.0	4274.9	6.9886				
1000	.023 10	3990.9	4568.5	7.3802	.019 196	3978.8	4554.7	7.2867	.016 410	3966.7	4541.1	7.2064				
1100	.025 12	4200.2	4828.2	7.5765	.020 903	4189.2	4816.3	7.4845	.017 895	4178.3	4804.6	7.4057				
1200	.027 11	4412.0	5089.9	7.7605	.022 589	4401.3	5079.0	7.6692	.019 360	4390.7	5068.3	7.5910				
1300	.029 10	4626.9	5354.4	7.9342	.024 266	4616.0	5344.0	7.8432	.020 815	4605.1	5333.6	7.7653				
P = 40.0 MPa																
375	.001 640 7	1677.1	1742.8	3.8290	.001 559 4	1638.6	1716.6	3.7639	.001 502 8	1609.4	1699.5	3.7141				
400	.001 907 7	1854.6	1930.9	4.1135	.001 730 9	1788.1	1874.6	4.0031	.001 633 5	1745.4	1843.4	3.9318				
425	.002 532	2096.9	2198.1	4.5029	.002 007	1959.7	2060.0	4.2734	.001 816 5	1892.7	2001.7	4.1626				
450	.003 693	2365.1	2512.8	4.9459	.002 486	2159.6	2284.0	4.5884	.002 085	2053.9	2179.0	4.4121				
500	.005 622	2678.4	2903.3	5.4700	.003 892	2525.5	2720.1	5.1726	.002 956	2390.6	2567.9	4.9321				
550	.006 984	2869.7	3149.1	5.7785	.005 118	2763.6	3019.5	5.5485	.003 956	2658.8	2896.2	5.3441				
600	.008 094	3022.6	3346.4	6.0114	.006 112	2942.0	3247.6	5.8178	.004 834	2861.1	3151.2	5.6452				
650	.009 063	3158.0	3520.6	6.2054	.006 966	3093.5	3441.8	6.0342	.005 595	3028.8	3364.5	5.8829				
700	.009 941	3283.6	3681.2	6.3750	.007 727	3230.5	3616.8	6.2189	.006 272	3177.2	3553.5	6.0824				
800	.011 523	3517.8	3978.7	6.6662	.009 076	3479.8	3933.6	6.5290	.007 459	3441.5	3889.1	6.4109				
900	.012 962	3739.4	4257.9	6.9150	.010 283	3710.3	4224.4	6.7882	.008 508	3681.0	4191.5	6.6805				
1000	.014 324	3954.6	4527.6	7.1356	.011 411	3930.5	4501.1	7.0146	.009 480	3906.4	4475.2	6.9127				
1100	.015 642	4167.4	4793.1	7.3364	.012 496	4145.7	4770.5	7.2184	.010 409	4124.1	4748.6	7.1195				
1200	.016 940	4380.1	5057.7	7.5224	.013 561	4359.1	5037.2	7.4058	.011 317	4338.2	5017.2	7.3083				
1300	.018 229	4594.3	5323.5	7.6969	.014 616	4572.8	5303.6	7.5808	.012 215	4551.4	5284.3	7.4837				
P = 50.0 MPa																
375	.001 640 7	1677.1	1742.8	3.8290	.001 559 4	1638.6	1716.6	3.7639	.001 502 8	1609.4	1699.5	3.7141				
400	.001 907 7	1854.6	1930.9	4.1135	.001 730 9	1788.1	1874.6	4.0031	.001 633 5	1745.4	1843.4	3.9318				
425	.002 532	2096.9	2198.1	4.5029	.002 007	1959.7	2060.0	4.2734	.001 816 5	1892.7	2001.7	4.1626				
450	.003 693	2365.1	2512.8	4.9459	.002 486	2159.6	2284.0	4.5884	.002 085	2053.9	2179.0	4.4121				
500	.005 622	2678.4	2903.3	5.4700	.003 892	2525.5	2720.1	5.1726	.002 956	2390.6	2567.9	4.9321				
550	.006 984	2869.7	3149.1	5.7785	.005 118	2763.6	3019.5	5.5485	.003 956	2658.8	2896.2	5.3441				
600	.008 094	3022.6	3346.4	6.0114	.006 112	2942.0	3247.6	5.8178	.004 834	2861.1	3151.2	5.6452				
650	.009 063	3158.0	3520.6	6.2054	.006 966	3093.5	3441.8	6.0342	.005 595	3028.8	3364.5	5.8829				
700	.009 941	3283.6	3681.2	6.3750	.007 727	3230.5	3616.8	6.2189	.006 272	3177.2	3553.5	6.0824				
800	.011 523	3517.8	3978.7	6.6662	.009 076	3479.8	3933.6	6.5290	.007 459	3441.5	3889.1	6.4109				
900	.012 962	3739.4	4257.9	6.9150	.010 283	3710.3	4224.4	6.7882	.008 508	3681.0	4191.5	6.6805				
1000	.014 324	3954.6	4527.6	7.1356	.011 411	3930.5	4501.1	7.0146	.009 480	3906.4	4475.2	6.9127				
1100	.015 642	4167.4	4793.1	7.3364	.012 496	4145.7	4770.5	7.2184	.010 409	4124.1	4748.6	7.1195				
1200	.016 940	4380.1	5057.7	7.5224	.013 561	4359.1	5037.2	7.4058	.011 317	4338.2	5017.2	7.3083				
1300	.018 229	4594.3	5323.5	7.6969	.014 616	4572.8	5303.6	7.5808	.012 215	4551.4	5284.3	7.4837				

TABLE 4

<i>p</i> (t Sat.) MPa	Liquid											
	0				2.5 (223.99)				5.0 (263.99)			
<i>t</i>	$10^3 v$	μ	<i>h</i>	<i>s</i>	$10^3 v$	μ	<i>h</i>	<i>s</i>	$10^3 v$	μ	<i>h</i>	<i>s</i>
Sat.												
0	1.0002	-0.03	-0.03	-0.0001	0.9990	-0.00	2.50	-0.0000	0.9977	0.04	5.04	0.0001
20	1.0018	83.95	83.95	0.2966	1.0006	83.80	86.30	0.2961	0.9995	83.65	88.65	0.2956
40	1.0078	167.56	167.56	0.5725	1.0067	167.25	169.77	0.5715	1.0056	166.95	171.97	0.5705
60	1.0172	251.12	251.12	0.8312	1.0160	250.67	253.21	0.8298	1.0149	250.23	255.30	0.8285
80	1.1291	334.87	334.87	1.0753	1.0280	334.29	336.86	1.0737	1.0268	333.72	338.85	1.0720
100	1.0436	418.96	418.96	1.3069	1.0423	418.24	420.85	1.3050	1.0410	417.52	422.72	1.3030
120	1.0604	503.57	503.57	1.5278	1.0590	502.68	505.33	1.5255	1.0576	501.80	507.09	1.5233
140	1.0800	588.89	588.89	1.7395	1.0784	587.82	590.52	1.7369	1.0768	586.76	592.15	1.7343
160	1.1024	675.19	675.19	1.9434	1.1006	673.90	676.65	1.9404	1.0988	672.62	678.12	1.9375
180	1.1283	762.72	762.72	2.1410	1.1261	761.16	763.97	2.1375	1.1240	759.63	765.25	2.1341
200	1.1581	851.8	851.8	2.3334	1.1555	849.9	852.8	2.3294	1.1530	848.1	853.9	2.3255
210	1.1749	897.1	897.1	2.4281	1.1720	895.0	898.0	2.4238	1.1691	893.0	898.8	2.4195
220	1.1930	943.0	943.0	2.5221	1.1898	940.7	943.7	2.5174	1.1866	938.4	944.4	2.5128
230	1.2129	989.6	989.6	2.6157	1.2092	987.0	990.1	2.6105	1.2056	984.5	990.6	2.6055
240	1.2347	1037.1	1037.1	2.7091	1.2305	1034.2	1037.2	2.7034	1.2264	1031.4	1037.5	2.6979
250	1.2590	1085.6	1085.6	2.8027	1.2540	1082.3	1085.4	2.7964	1.2493	1079.1	1085.3	2.7902
260	1.2862	1135.4	1135.4	2.8970	1.2804	1131.6	1134.8	2.8898	1.2749	1127.9	1134.3	2.8830
270	1.3173	1186.8	1186.8	2.9926	1.3102	1182.4	1185.7	2.9844	1.3036	1178.2	1184.3	2.9766
280	1.3535	1240.4	1240.4	3.0904	1.3447	1235.1	1238.5	3.0808	1.3365	1230.2	1236.8	3.0717
290	1.3971	1297.0	1297.0	3.1918	1.3855	1290.5	1294.0	3.1801	1.3750	1284.4	1291.3	3.1693
300	1.4520	1358.1	1358.1	3.2992	1.4357	1349.6	1353.2	3.2843	1.4214	1341.9	1349.0	3.2708
310									1.4803	1404.1	1411.5	3.3789

FIGURE 5.11a Extract from subcooled table (SI units).

TABLE A.4 (SI)
Properties of Compressed Liquid (Steam)

T	P = 5 MPa (263.99)					P = 10 MPa (311.06)					P = 15 MPa (342.24)				
	v	u	h	s		v	u	h	s		v	u	h	s	
Sat.	.001 285 9	1147.8	1154.2	2.9202		.001 452 4	1393.0	1407.6	3.3596		.001 658 1	1585.6	1610.5	3.6848	
0	.000 997 7	.04	5.04	.0001		.000 995 2	.09	10.04	.0002		.000 992 8	.15	15.05	.0004	
20	.000 999 5	83.65	88.65	.2956		.000 997 2	83.36	93.33	.2945		.000 995 0	83.06	97.99	.2934	
40	.001 005 6	166.95	171.97	.5705		.001 003 4	166.35	176.38	.5686		.001 001 3	165.76	180.78	.5666	
60	.001 014 9	250.23	255.30	.8285		.001 012 7	249.36	259.49	.8258		.001 010 5	248.51	263.67	.8232	
80	.001 026 8	333.72	338.85	1.0720		.001 024 5	332.59	342.83	1.0688		.001 022 2	331.48	346.81	1.0656	
100	.001 041 0	417.52	422.72	1.3030		.001 038 5	416.12	426.50	1.2992		.001 036 1	414.74	430.28	1.2955	
120	.001 057 6	501.80	507.09	1.5233		.001 054 9	500.08	510.64	1.5189		.001 052 2	498.40	514.19	1.5145	
140	.001 076 8	586.76	592.15	1.7343		.001 073 7	584.68	595.42	1.7292		.001 070 7	582.66	598.72	1.7242	
160	.001 098 8	672.62	678.12	1.9375		.001 095 3	670.13	681.08	1.9317		.001 091 8	667.71	684.09	1.9260	
180	.001 124 0	759.63	765.25	2.1341		.001 119 9	756.65	767.84	2.1275		.001 115 9	753.76	770.50	2.1210	
200	.001 153 0	848.1	853.9	2.3255		.001 148 0	844.5	856.0	2.3178		.001 143 3	841.0	858.2	2.3104	
220	.001 186 6	938.4	944.4	2.5128		.001 180 5	934.1	945.9	2.5039		.001 174 8	929.9	947.5	2.4953	
240	.001 226 4	1031.4	1037.5	2.6979		.001 218 7	1026.0	1038.1	2.6872		.001 211 4	1020.8	1039.0	2.6771	
260	.001 274 9	1127.9	1134.3	2.8830		.001 264 5	1121.1	1133.7	2.8699		.001 255 0	1114.6	1133.4	2.8576	
280						.001 321 6	1220.9	1234.1	3.0548		.001 308 4	1212.5	1232.1	3.0393	
300						.001 397 2	1328.4	1342.3	3.2469		.001 377 0	1316.6	1337.3	3.2260	
320											.001 472 4	1431.1	1453.2	3.4247	
340											.001 631 1	1567.5	1591.9	3.6546	

TABLE A.4 (SI) (cont'd.)

T	P = 20 MPa (365.81)					P = 30 MPa					P = 50 MPa				
	v	u	h	s	s	v	u	h	s	s	v	u	h	s	s
Sat.	.002 036	1785.6	1826.3	4.0139		.000 985 6	.25	29.82	.0001		.000 976 6	.20	49.03	.0014	
0	.000 990 4	.19	20.01	.0004		.000 988 6	82.17	111.84	.2899		.000 980 4	81.00	130.02	.2848	
20	.000 992 8	82.77	102.62	.2923		.000 995 1	164.04	193.89	.5607		.000 987 2	161.86	211.21	.5527	
40	.000 999 2	165.17	185.16	.5646		.001 004 2	246.06	276.19	.8154		.000 996 2	242.98	292.79	.8052	
60	.001 008 4	247.68	267.85	.8206		.001 015 6	328.30	358.77	1.0561		.001 007 3	324.34	374.70	1.0440	
80	.001 019 9	330.40	350.80	1.0624		.001 029 0	410.78	441.66	1.2844		.001 020 1	405.88	456.89	1.2703	
100	.001 033 7	413.39	434.06	1.2917		.001 044 5	493.59	524.93	1.5018		.001 034 8	487.65	539.39	1.4857	
120	.001 049 6	496.76	517.76	1.5102		.001 062 1	576.88	608.75	1.7098		.001 051 5	569.77	622.35	1.6915	
140	.001 067 8	580.69	602.04	1.7193		.001 082 1	660.82	693.28	1.9096		.001 070 3	652.41	705.92	1.8891	
160	.001 088 5	665.35	687.12	1.9204		.001 104 7	745.59	778.73	2.1024		.001 091 2	735.69	790.25	2.0794	
180	.001 112 0	750.95	773.20	2.1147		.001 130 2	831.4	865.3	2.2893		.001 114 6	819.7	875.5	2.2634	
200	.001 138 8	837.7	860.5	2.3031		.001 159 0	918.3	953.1	2.4711		.001 140 8	904.7	961.7	2.4419	
220	.001 169 3	925.9	949.3	2.4870		.001 192 0	1006.9	1042.6	2.6490		.001 170 2	990.7	1049.2	2.6158	
240	.001 204 6	1016.0	1040.0	2.6674		.001 230 3	1097.4	1134.3	2.8243		.001 203 4	1078.1	1138.2	2.7860	
260	.001 246 2	1108.6	1133.5	2.8459		.001 275 5	1190.7	1229.0	2.9986		.001 241 5	1167.2	1229.3	2.9537	
280	.001 296 5	1204.7	1230.6	3.0248		.001 330 4	1287.9	1327.8	3.1741		.001 286 0	1258.7	1323.0	3.1200	
300	.001 359 6	1306.1	1333.3	3.2071		.001 399 7	1390.7	1432.7	3.3539		.001 338 8	1353.3	1420.2	3.2868	
320	.001 443 7	1415.7	1444.6	3.3979		.001 492 0	1501.7	1546.5	3.5426		.001 403 2	1452.0	1522.1	3.4557	
340	.001 568 4	1539.7	1571.0	3.6075		.001 626 5	1626.6	1675.4	3.7494		.001 483 8	1556.0	1630.2	3.6291	
360	.001 822 6	1702.8	1739.3	3.8772		.001 869 1	1781.4	1837.5	4.0012		.001 588 4	1667.2	1746.6	3.8101	
380															