

NATIONAL EXAMINATIONS

May 2013

07-MEC-B3 ENERGY CONVERSION AND POWER GENERATION

Three hours duration

Notes to Candidates

1. This is a **Closed Book** examination.
2. Examination paper consists of two Sections. **Section A is Calculative** with four (4) questions and **Section B is Descriptive** with two (2) questions. Descriptive questions must be comprehensively answered (in approximately 3 pages).
3. **Do three (3) questions (including all parts of each question) from Section A (Calculative) and one (1) question from Section B (Descriptive).**

Note that Question 1 is on two pages.
4. **Four questions constitute a complete paper. (Total 60 marks).**
5. **All questions are of equal value. (Each 15 marks).**
6. If doubt exists as to the interpretation of any question or in the event of missing data, the candidate is urged to submit, with the answer paper, a clear statement of any assumptions made.
7. Candidates may use one of the approved **Casio** or **Sharp** calculators.
8. **Reference data** for particular questions are given on pages 9 to 12. **All pages used are to be returned with the answer booklet showing where data has been obtained.**
9. **Reference formulae and constants** are given on pages 13 to 16.
10. **Steam Tables** from "Thermodynamics and Heat Power" are provided.

SECTION A CALCULATIVE SECTION

QUESTION 1 THERMAL POWER PLANT

Refer to the Examination Paper Attachments **Matla Power Station** on Page 9. The table on this page is for orientation only. *The data given below must be used in the calculations but the answers obtained may be compared with the data in the table.*

Refer also to the Examination Paper Attachments **Cooling Tower Evaporation Loss** on Page 10. Use this diagram for part (h) below.

A coal fired power plant similar to Matla is planned for a particular site. Some basic parameters regarding resources and environmental impact are required before proceeding with the detailed design and specifications. The following technical data apply to the proposed site and to a typical large coal fired plant:

Electrical generator output	= 600 MW (for each unit)
Number of units	= 6 (for whole station)
Steam cycle efficiency	= 48%
Boiler efficiency	= 90%
Coal calorific value	= 20 MJ/kg
Coal ash content	= 25%
Coal carbon content	= 60%
Main steam pressure	= 17 MPa
Main steam temperature	= 500°C
Feedwater pressure	= 20 MPa
Feedwater temperature	= 280°C
Reheat steam pressure	= 3 MPa
Reheat steam temperature	= 500°C
Reheat return pressure	= 3 MPa
Reheat return temperature	= 300°C
Cooling water temperature	= 20°C
Cooling water temperature rise	= 12°C
Atmospheric temperature	= 32°C
Atmospheric relative humidity	= 20%

This question is continued on the next page

Question 1 Continued

For full load conditions determine the following:

- (a) (i) Rate of heat input to the steam cycle (kJ/s), (ii) rate of heat input by the fuel (kJ/s) and (iii) rate of heat rejection to the cooling water (kJ/s). (2)
- (b) Heat rate (heat required per unit of electricity) for the unit (kJ/kWh). (1)
- (c) Coal consumption rate for each unit (kg/s) as well as for the whole plant (Mg/h). (1)
- (d) (i) Ash production rate for each unit (kg/s) as well as (ii) ash production for the whole plant (Mg/h). (1)
- (e) Carbon dioxide emission rate for the whole plant (Mg/h). (1)
- (f) Steam flow rate from each boiler to the turbine (kg/s) assuming that the reheat steam flow is the same as the main steam flow. (4)
- (g) (i) Cooling water flow rate for each unit (m^3/s) as well as (ii) cooling water flow rate for each of two 50% pumps on the unit (m^3/s). (1)
- (h) (i) Make-up water required (evaporative loss) for the cooling tower of each unit (m^3/h) as well (ii) make-up water required as for the whole plant (m^3/h). (2)

If the power plant operates as a base load plant with an annual operating capacity factor of 75% determine the following yearly requirements for a six unit station.

- (i) (i) Annual electricity production (GWh)
 (ii) Annual coal feed requirements (Mg/year (tonnes/annum))
 (iii) Annual ash disposal requirements (Mg/year (tonnes/annum))
 (iv) Annual cooling water make-up requirements (m^3/year)
 (v) Annual carbon dioxide emissions (Mg/year (tonnes/annum)) (2)

[15 marks]

QUESTION 2 COMBINED CYCLE PLANT

Refer to the Examination Paper Attachments Page 11 Combined Cycle Plant

In a combined cycle power plant based on a Brayton and a Rankine Cycle, as shown in the attached sketch on Page 11, the gas turbine exhaust heat is used to generate steam. The gas turbine cycle is an open cycle while the steam turbine cycle is a closed cycle with one stage of feedwater heating operating on the direct contact principle with steam bled from the turbine. The gas cycle has an air compressor, a combustion chamber, a gas turbine and a heat recovery steam generator. The steam cycle has, besides the heat recovery steam generator, a steam turbine, a steam condenser, a condensate pump, a direct contact heat exchanger and a feedwater pump. The combined cycle is illustrated on Page 11 with appropriate conditions given at various points.

Assume a cold air standard cycle (constant specific heats with $k = 1.4$). For a gas mass flow of 100 kg/s calculate the following:

- (a) Rate of heat input to combustion chamber. (1)
- (b) Mass flow rate of main steam. (1)
- (c) Mass flow rate of bled steam. (1)
- (d) Power (net) generated by gas turbine. (2)
- (e) Power generated by steam turbine. (2)
- (f) Efficiency of air compressor. (2)
- (g) Efficiency of gas turbine. (2)
- (h) Efficiency (internal) of steam turbine. (2)
- (i) Work done by pumps (1)
- (j) Overall efficiency of plant assuming that the power for the condensate and feedwater pumps is taken from the steam turbine output. (1)

[15 marks]

QUESTION 3 BELLEDUNE HEAT BALANCE DIAGRAM

Refer to the Examination Paper Attachments Page 12 Heat Balance Diagram for Belledune Generating Station.

At the rated electrical output of 430 MW determine the following:

- (a) Steam cycle efficiency based on boiler heat input and electrical output. (3)
- (b) Shaft power output of high pressure turbine. (4)
- (c) Steam power input to boiler feed water pump turbine based on steam conditions. (2)
- (d) Shaft power input to boiler feedwater pump based on enthalpy rise (Δh) in the pump. (2)
- (e) Hydraulic power output of the boiler feedwater pump based on pressure rise (P_D is Deaerator Pressure) in the pump. The density of water at the pump is 912 kg/m^3 . (3)
- (f) Feedwater pump efficiency. (1)

[15 marks]

QUESTION 4 PWR HEAT GENERATION

A typical Pressurised Water Reactor has the following core characteristics:

Number of Fuel Assemblies in Reactor	157
Number of Fuel Rods per Assembly	264 (17 x 17 array)
Fuel Rod Outside Diameter	9.5 mm
Fuel Rod Cladding Thickness	0.57 mm
Fuel Pellet Diameter	8.19 mm
Fuel Rod Lattice Pitch	12.6 mm
Fuel Rod Effective Length	3.658 m
Equivalent Reactor Core Diameter	3.040 m
Uranium Dioxide Density	10 400 kg/m ³
Reactor Coolant Inlet Temperature	286°C
Reactor Coolant Outlet Temperature	325°C
Coolant Flow Rate through Reactor Core	12 600 kg/s
Coolant Pressure	15.5 MPa
Average U-235 Enrichment	2.8 %
Effective U-235 Fission Cross Section	380 barns
Average Neutron Flux	4.5 x 10 ¹³ neutron/cm ² s
Energy per Fission	32 pJ

Determine the following assuming uniform conditions throughout the reactor core.

- (a) Mass of fuel (uranium dioxide) in reactor (kg) (2)
- (b) Total heat release rate in fuel (MW) (6)
- (c) Average fuel power density (UO₂) (kW/kg) (1)
- (d) Average core power density (MW/m³) (1)
- (e) Average fuel rod heat flux (kW/m²) (2)
- (f) Thermal power output based on coolant flow rate (MW) (3)

The molecular mass of the fuel may be determined from the atomic mass numbers of the dominant isotopes of uranium dioxide.

Note: 1 barn = 10⁻²⁸ m²

[15 marks]

SECTION B DESCRIPTIVE SECTION

Descriptive questions should be answered in essay form with sketches, if appropriate, and taking approximately one full page for every 5 marks. A full page means approximately 250 words unless diagrams take the place of some words.

While each part of each question specifies several aspects, more emphasis may be put on one or more aspects and less on others provided an overall comprehensive answer is given as required by the above.

QUESTION 5 BOILER AND REACTOR PRINCIPLES

PART I PULVERISED COAL FIRING

- (a) Describe, with the aid of a diagram, the coal firing process of a large pulverised fuel fired boiler. The sketch should include the coal hopper, coal feeder, coal pulveriser, primary air fan, windbox and burners. The flows of coal and air must be shown clearly.
- (b) Explain the process making reference to the coal size and how it is classified (graded) as well as air temperature and how it is controlled. Give reasons for these requirements. Clarify how and why the air-fuel ratio is different at the pulveriser and at the burner.

(8 marks)

PART II NUCLEAR REACTOR COMPONENTS

- (a) Describe, with the aid of a sketch, the configuration of a typical nuclear thermal fission reactor. The sketch must show the fuel, moderator, coolant and control rods in the proper alignment so as to clarify their relationship with one another in the fission process.
- (b) Explain the fission process making reference to the need for the four components listed above. Clarify in particular the nuclear cycle from one fission to the next and how the fission heat is removed effectively.

(7 marks)

[15 marks]

QUESTION 6 ENVIRONMENTAL IMPACT

Compare the environmental impact of large scale electric power generation from each of the following (all three) sources of energy:

- ~ Coal (fossil fuel combustion)
- ~ Nuclear (nuclear fission)
- ~ Hydro (renewable energy)

- (a) For each explain the physical impact or disruption of the environment to build the plant and to supply the energy required. Suggest ways of alleviating the problems.

(3 marks)

- (b) For each explain what detrimental effluents are produced during operation and by what mechanism and to what degree they can be minimised.

(5 marks)

- (c) For each explain what solid waste products are produced and how these products may be disposed of in a way that will not be detrimental to the environment.

(5 marks)

- (d) Given the evidence presented in your answers to the above, rank the three sources of energy in order of importance (installed MW) currently and their likely order of importance (installed MW) in the future (say 50 years time). Give reasons for the ranking.

(2 marks)

[15 marks]

EXAMINATION PAPER ATTACHMENTS

QUESTION 1 MATLA POWER STATION

Technical data for 6 x 600 MW Coal Fired Power Plant

Technical data

Generating capacity	3 600 MW
Employees	1 900
Operating	3 shifts of 90 In 24 hours
Fuel	
Mining company	General Mining and Finance Corp. (S.A.)
Calorific value	between 15,8 and 20,8 MJ/kg
Ash content	between 17,5% and 33%
Total annual production	9,5 million tons
Coal storage capacity	
no. 1	110 000 tons
no. 2	55 000 tons
Boiler bunker capacity	28 800 tons
Coal consumed at full load	1 600 tons per hour
Milling plant	
Manufacturer	B.E.C.
Type	12,9E vertical spindle ball mills with 11 x 970 mm balls
Number	6 per boiler (36)
Speed	25 r.p.m.
Rated output	20,9 kg/s
Boilers	
Manufacturer	B.E.C.
Number	6
Maximum continuous rating	493,4 kg/sec.
Final steam pressure	18,97 MPa (abs)
Final steam temperature	540°C
No. of burners	48
Height	65 m
Width	24 m
Depth	13,7 m
Furnace flame temperature	approximately 1 500°C
Steam drum	
Manufacturer	
Sets 1-3	Vecor
Sets 4-6	Babcock & Wilcox Renfrew (U.K.)
Length	25,9 m
Internal diameter	2,21 m
Turbines	
Manufacturer	M.A.N. (Germany)
Type	4 cylinder tandem impulse
Rating	600 MW
Speed	3 000 r.p.m.
Heat consumption (MCR)	8 330,8 kJ/kWh

Generator	
Manufacturer	Alsthom (France)
Rated capacity	667 MVA
Terminal voltage	20 kV, 50 Hz
Power factor	0,9 lagging
Cooling medium	hydrogen at 500 kPa
Generator-transformer	
Sets 1 and 2	
Manufacturer	Toshiba Mitui (Japan)
Rated capacity	700 MVA
Terminal voltage: primary	20 kV
secondary	420 kV
Sets 3-6	
Manufacturer	ASEA (S.A.)
Rated capacity	700 MVA
Terminal voltage: primary	20 kV
secondary	300 kV
Cooling towers	
Number	6
Type	hyperbolic natural draught
Overall dimensions:	
Sets 1-3	
height	149 m
pond diameter	102 m
throat	54,6 m
Sets 4-6	
height	128 m
pond diameter	94,5 m
throat	48,8 m
Evaporation at 600 MW	1 250 m ³ /h
Circulating water pumps	
Manufacturer	Salweir
Number	12
Capacity	6,48 m ³ /sec. each
Chimneys	
Number	2
No. 1 (single-flue)	
height	213 m
top diameter	14 m
base diameter	25 m
No. 2 (multi-flue)	
height	275 m
top diameter	18,5 m
base diameter	22 m

EXAMINATION PAPER ATTACHMENTS

NAME

QUESTION 1 COOLING TOWER EVAPORATION LOSS

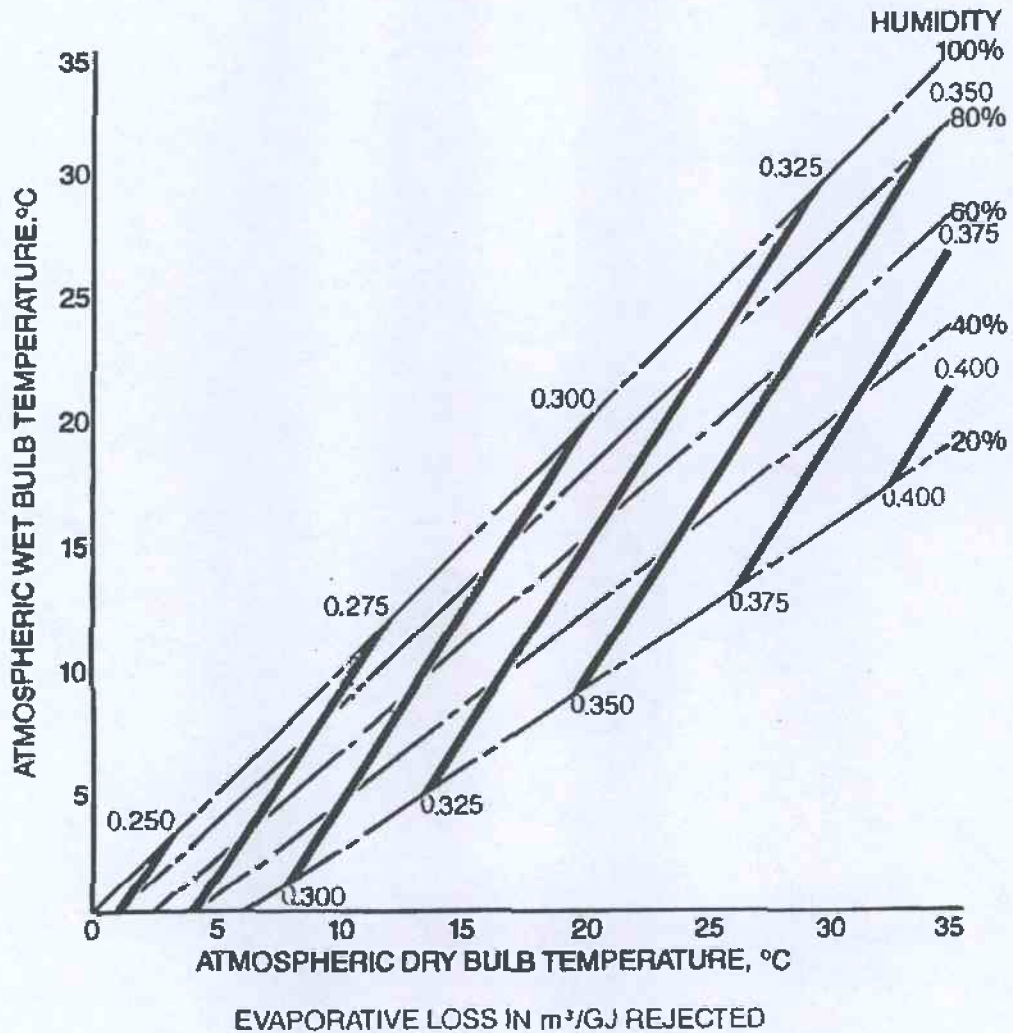


FIG. 7.138 Evaporative loss from natural draught cooling towers


The chart is used to estimate the evaporative loss in m^3/GJ of heat rejected.

07-MEC-B3

NAME

QUESTION 2 COMBINED CYCLE PLANT

SYSTEM DIAGRAM

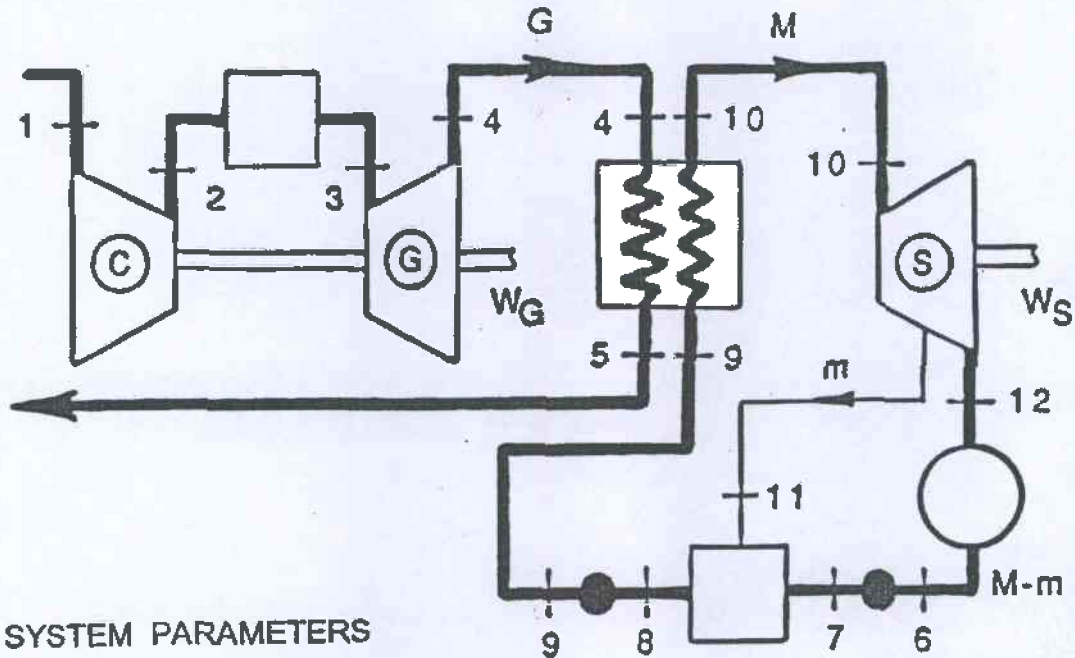


SYSTEM PARAMETERS

Point	Pressure (MPa)	Temperature (°C)	Enthalpy (kJ/kg)
1	0.1	30	
2S	1.2	344	
2	1.2	422	
3	1.2	1000	
4S	0.1	353	
4	0.1	418	
5	0.1	159	
6	0.005	33	136
7	0.4	33	136
8	0.4	144	605
9	5.0	144	610
10	5.0	400	3196
11S	0.4	144	2634
11	0.4	144	2719
12SS	0.005	33	
12S	0.005	33	2025
12	0.005	33	2201

Note that s represents isentropic conditions.

QUESTION 3 HEAT BALANCE DIAGRAM FOR BELLEDUNE GENERATING STATION

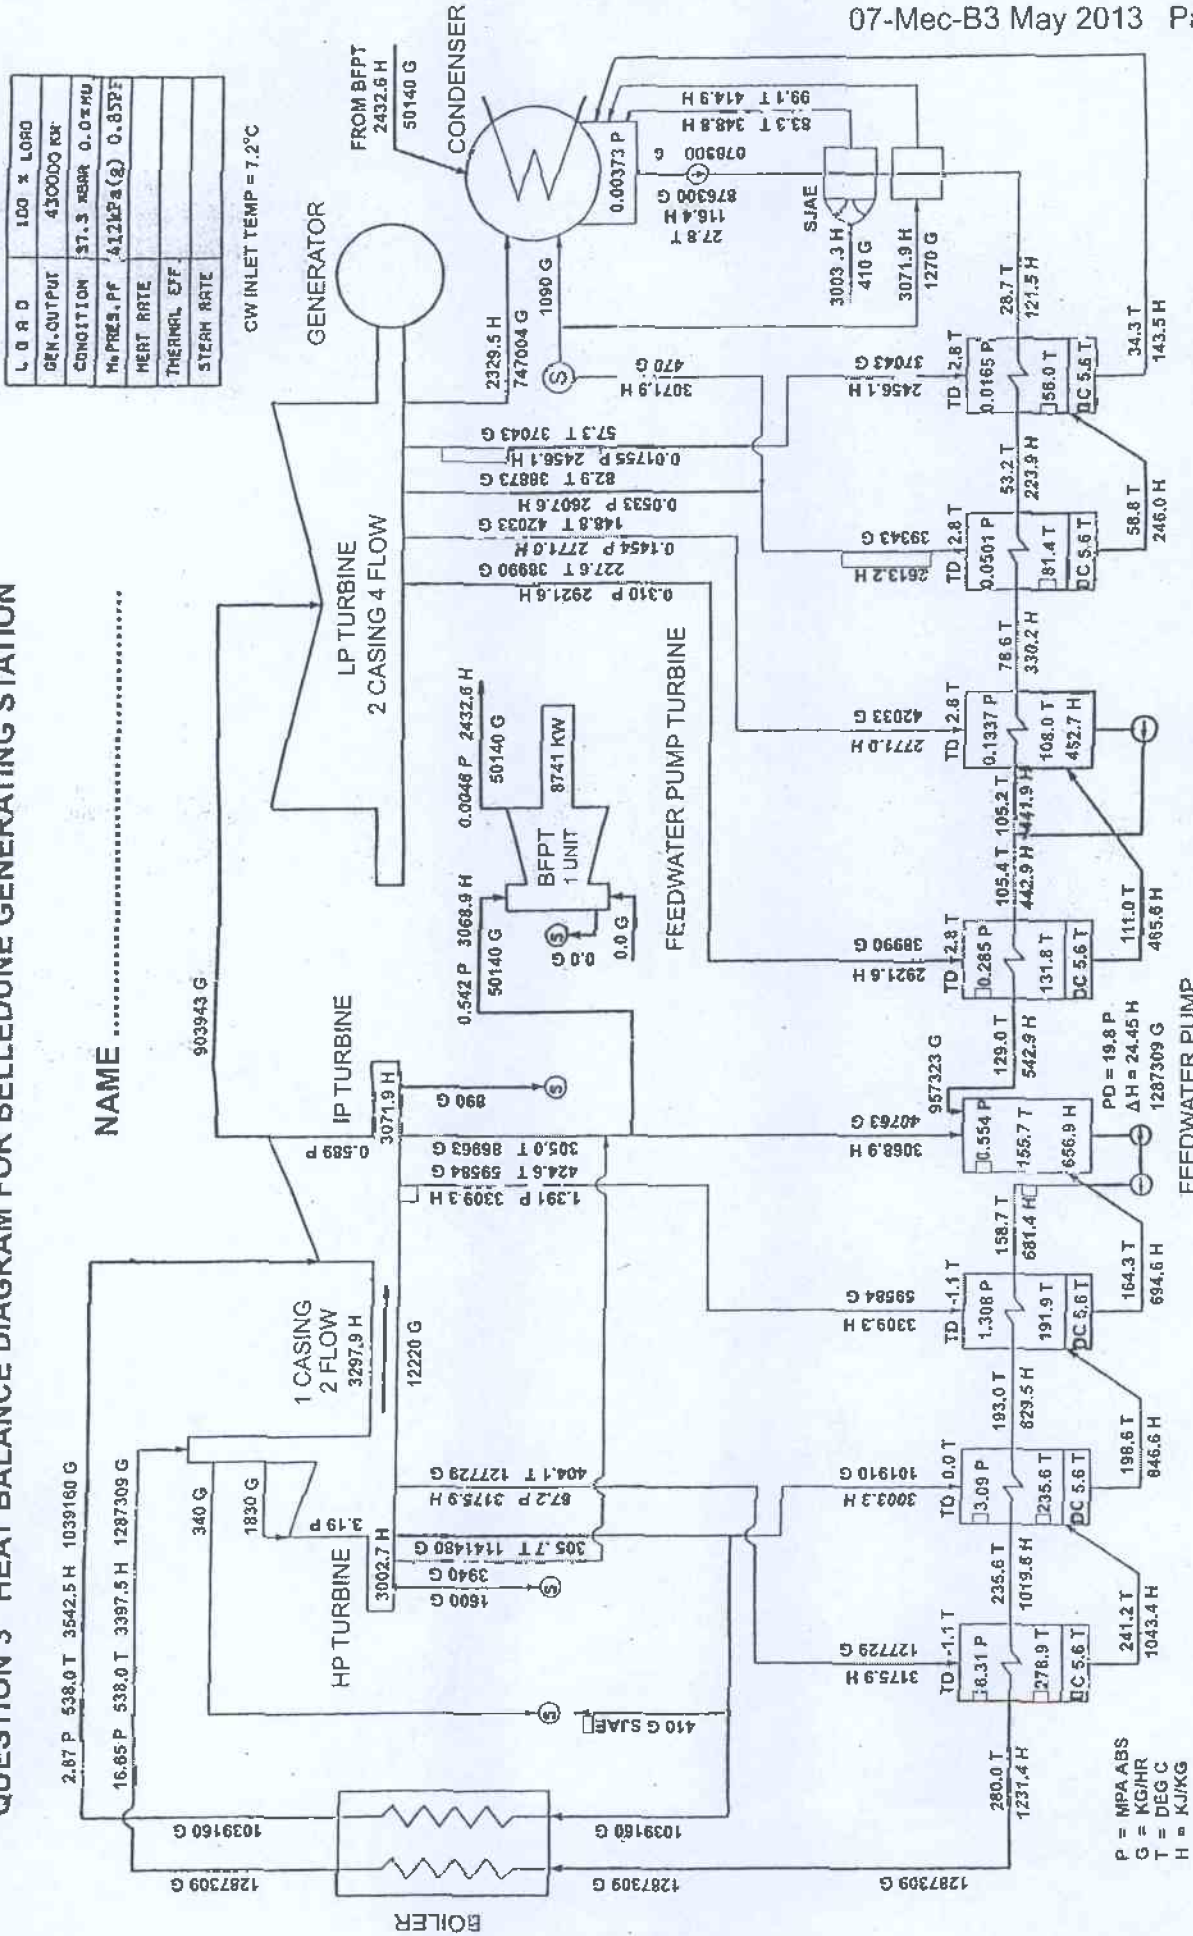

L O R D	100 % L O R D
GEN. OUTPUT	430000 KW
CONDITION	ST.3 REAR 0.0%RU
% PRES. PF	412KPa (g) 0.85PF
HEAT RATE	
THERMAL EFF.	
STEAM RATE	

CW INLET TEMP = 7.2°C

NAME

APPROVED BY	MESSER	DESIGNING	REHEAT
CHECKED BY	MESSER	GENERATING	TURBINE
DESIGNED BY	MESSER	STATION UNIT-1	430000 KW
ED BY	MESSER	REAR COND 1600MVA GEN.1	HEAT BALANCE DIAGRAM
		TOSHIBA CORPORATION	3K3001731

P = MPA ABS
G = KG/HR
T = DEG C
H = KJ/KG

NOMENCLATURE FOR REFERENCE EQUATIONS (SI UNITS)

A	Flow area, Surface area	m^2
c_p	Specific heat at constant pressure	$J/kg^\circ C$
c_v	Specific heat at constant volume	$J/kg^\circ C$
D	Diameter	m
E	Energy	J
g	Gravitational acceleration	m/s^2
h	Specific enthalpy	J/kg
k	Ratio of specific heats	
L	Length	m
m	Fractional mass flow rate	
M	Mass flow rate	kg/s
p	Pressure	$Pa(N/m^2)$
q	Heat transferred	J/kg
Q	Heat	J
R	Specific gas constant	$J/kg K$
s	Entropy	$J/kg K$
T	Temperature	K
u	Specific internal energy	J/kg
v	Specific volume	m^3/kg
V	Velocity	m/s
w	Specific work	J/kg
W	Work	J
x	Length	m
z	Elevation	m
η	Efficiency	
θ	Nozzle angle	
μ	Dynamic viscosity	Ns/m^2
ν	Kinematic viscosity	m^2/s
ρ	Density	kg/m^3
τ	Thrust	N
Ω	Heat transfer rate	J/s

GENERAL CONSTANTS

Acceleration due to gravity: $g = 9.81 \text{ m/s}^2$	Specific heat of air: $c_p = 1.005 \text{ kJ/kg}^\circ\text{C}$
Atmospheric pressure: $p_{atm} = 100 \text{ kPa}$	Specific heat of air: $c_v = 0.718 \text{ kJ/kg}^\circ\text{C}$
Density of water: $\rho_{water} = 1000 \text{ kg/m}^3$	Specific heat of helium: $c_p = 5.193 \text{ kJ/kg}^\circ\text{C}$
Specific heat of water: $c_p = 4.190 \text{ kJ/kg}^\circ\text{C}$	Specific heat of helium: $c_v = 3.117 \text{ kJ/kg}^\circ\text{C}$

THERMODYNAMICS REFERENCE EQUATIONS**Basic Thermodynamics**

First Law:	$dE = \delta Q - \delta W$
Enthalpy:	$h = u + pv$
Continuity:	$\rho VA = \text{constant}$
Flow Work:	$w = \Delta(pv)$
Energy Equation:	$zg + V^2/2 + u + pv + \Delta w + \Delta q = \text{constant}$
Entropy:	$\Delta s = \Sigma \delta q / T$ (reversible conditions)

Ideal Gas Relationships

Gas Law:	$pv = RT$
Specific Heat at Constant Pressure:	$c_p = \Delta h / \Delta T$
Specific Heat at Constant Volume:	$c_v = \Delta u / \Delta T$
Gas Constant:	$R = c_p - c_v$
Specific Heat Ratio:	$k = c_p / c_v$
Isentropic Relations:	$p_1 / p_2 = (v_2 / v_1)^k = (T_1 / T_2)^{k/(k-1)}$

FLUID MECHANICS REFERENCE EQUATIONS

Fluid Mechanics

Continuity Equation:	$\rho_1 V_1 A_1 = \rho_2 V_2 A_2 = M$
Bernoulli's Equation:	$p_1/\rho g + z_1 + V_1^2/2g = p_2/\rho g + z_2 + V_2^2/2g$
Momentum Equation:	$F = p_1 A_1 - p_2 A_2 - \rho V A (V_2 - V_1)$ (one dimensional)

Steam Turbines

Nozzle Equation:	$h_1 - h_2 = (V_2^2 - V_1^2) / 2$
Work:	$w = [(V_1^2_{\text{absolute}} - V_2^2_{\text{absolute}}) + (V_2^2_{\text{relative}} - V_1^2_{\text{relative}})] / 2$

Gas Turbines

State Equation:	$p v = R T$
Isentropic Equation:	$(T_2/T_1) = (p_2/p_1)^{(k-1)/k}$
Enthalpy Change:	$h_1 - h_2 = c_p (T_1 - T_2)$ (ideal gas)
Nozzle Equation:	$h_1 - h_2 = (V_2^2 - V_1^2) / 2$

Jet Propulsion

Thrust:	$\tau = M(V_{\text{jet}} - V_{\text{aircraft}})$
Thrust Power:	$\tau V_{\text{aircraft}} = M(V_{\text{jet}} - V_{\text{aircraft}}) V_{\text{aircraft}}$
Jet Power:	$P = M(V_{\text{jet}}^2 - V_{\text{aircraft}}^2) / 2$
Propulsion Efficiency:	$\eta_p = 2V_{\text{aircraft}} / (V_{\text{jet}} + V_{\text{aircraft}})$

Wind Turbine

Maximum Ideal Power:	$P_{\text{max}} = 8 \rho A V_1^3 / 27$
----------------------	--

NUCLEAR REFERENCE EQUATIONS

Number of nuclei per gram of material

$$N = N_A / M$$

Number of fissile nuclei per cm³ of material

$$N_f = \gamma (N_A / M) \rho$$

Heat release rate in nuclear fuel

$$q^* = \phi N_f \sigma_f E_f$$

Nomenclature

N	=	number of nuclei (number/g)
N _A	=	Avogadro's Number
M	=	molecular weight
γ	=	fuel enrichment
ρ	=	density (g/cm ³)
q*	=	heat release rate (J/cm ³)
φ	=	neutron flux (neutrons/cm ² s)
N _f	=	number of fissile nuclei (number/cm ³)
σ _f	=	cross section (barn) (1 barn = 10 ⁻²⁴ cm ²)
E _f	=	energy release per fission of one atom

Avogadro's Number

$$N_A = 0.602 \times 10^{24} \text{ atoms/mole}$$

Thermodynamics and Heat Power

SIXTH EDITION

Irving Granet, P.E.

late, Queensborough Community College of City University of New York

Maurice Bluestein, Ph.D.

Indiana University—Purdue University, Indianapolis

PRENTICE HALL

Upper Saddle River, New Jersey Columbus, Ohio

TABLE A.1 (SI)
Saturation: Temperature (Steam)

Temp. °C <i>T</i>	Press. kPa <i>P</i>	Specific Volume (m ³ /kg)		Internal Energy (kJ/kg)				Enthalpy (kJ/kg)				Entropy (kJ/kg · °K)			
		Sat. Liquid <i>v_f</i>	Sat. Vapor <i>v_g</i>	Sat. Liquid <i>u_f</i>	Evap. <i>u_{fg}</i>	Sat. Vapor <i>u_g</i>	Sat. Liquid <i>h_f</i>	Evap. <i>h_{fg}</i>	Sat. Vapor <i>h_g</i>	Sat. Liquid <i>s_f</i>	Evap. <i>s_{fg}</i>	Sat. Vapor <i>s_g</i>			
0.01	0.6113	0.001 000	206.14	.00	2375.3	2375.3	.01	2501.3	2501.4	.0000	9.1562	9.1562			
5	0.8721	0.001 000	147.12	20.97	2361.3	2382.3	20.98	2489.6	2510.6	.0761	8.9496	9.0257			
10	1.2276	0.001 000	106.38	42.00	2347.2	2389.2	42.01	2477.7	2519.8	.1510	8.7498	8.9008			
15	1.7051	0.001 001	77.93	62.99	2333.1	2396.1	62.99	2465.9	2528.9	.2245	8.5569	8.7814			
20	2.339	0.001 002	57.79	83.95	2319.0	2402.9	83.96	2454.1	2538.1	.2966	8.3706	8.6672			
25	3.169	0.001 003	43.36	104.88	2304.9	2409.8	104.89	2442.3	2547.2	.3674	8.1905	8.5580			
30	4.246	0.001 004	32.89	125.78	2290.8	2416.6	125.79	2430.5	2556.3	.4369	8.0164	8.4533			
35	5.628	0.001 006	25.22	146.67	2276.7	2423.4	146.68	2418.6	2565.3	.5053	7.8478	8.3531			
40	7.384	0.001 008	19.52	167.56	2262.6	2430.1	167.57	2406.7	2574.3	.5725	7.6845	8.2570			
45	9.593	0.001 010	15.26	188.44	2248.4	2436.8	188.45	2394.8	2583.2	.6387	7.5261	8.1648			
50	12.349	0.001 012	12.03	209.32	2234.2	2443.5	209.33	2382.7	2592.1	.7038	7.3725	8.0763			
55	15.758	0.001 015	9.568	230.21	2219.9	2450.1	230.23	2370.7	2600.9	.7679	7.2234	7.9913			
60	19.940	0.001 017	7.671	251.11	2205.5	2456.6	251.13	2358.5	2609.6	.8312	7.0784	7.9096			
65	25.03	0.001 020	6.197	272.02	2191.1	2463.1	272.06	2346.2	2618.3	.8935	6.9375	7.8310			
70	31.19	0.001 023	5.042	292.95	2176.6	2469.6	292.98	2333.8	2626.8	.9549	6.8004	7.7553			
75	38.58	0.001 026	4.131	313.90	2162.0	2475.9	313.93	2321.4	2635.3	1.0155	6.6669	7.6824			
80	47.39	0.001 029	3.407	334.86	2147.4	2482.2	334.91	2308.8	2643.7	1.0753	6.5369	7.6122			
85	57.83	0.001 033	2.828	355.84	2132.6	2488.4	355.90	2296.0	2651.9	1.1343	6.4102	7.5445			
90	70.14	0.001 036	2.361	376.85	2117.7	2494.5	376.92	2283.2	2660.1	1.1925	6.2866	7.4791			
95	84.55	0.001 040	1.982	397.88	2102.7	2500.6	397.96	2270.2	2668.1	1.2500	6.1659	7.4159			

TABLE A.1 (SI) (cont'd.)

Temp. °C T	Press. MPa P	Specific Volume (m ³ /kg)				Internal Energy (kJ/kg)				Enthalpy (kJ/kg)				Entropy (kJ/kg · °K)			
		Sat. Liquid v_f	Sat. Vapor v_g	Sat. Liquid u_f	Sat. Vapor u_g	Sat. Vapor u_g	Sat. Vapor u_g	Sat. Vapor u_g	Sat. Vapor u_g	Sat. Vapor h_g	Sat. Vapor h_g	Sat. Vapor h_g	Sat. Vapor h_g	Sat. Vapor s_g	Sat. Vapor s_g	Sat. Vapor s_g	Sat. Vapor s_g
250	3.973	0.001 251	0.050 13	1080.39	1522.0	2602.4	1085.36	1716.2	2801.5	2.7927	3.2802	6.0730					
255	4.319	0.001 263	0.045 98	1104.28	1496.7	2600.9	1109.73	1689.8	2799.5	2.8383	3.1992	6.0375					
260	4.688	0.001 276	0.042 21	1128.39	1470.6	2599.0	1134.37	1662.5	2796.9	2.8838	3.1181	6.0019					
265	5.081	0.001 289	0.038 77	1152.74	1443.9	2596.6	1159.28	1634.4	2793.6	2.9294	3.0368	5.9662					
270	5.499	0.001 302	0.035 64	1177.36	1416.3	2593.7	1184.51	1605.2	2789.7	2.9751	2.9551	5.9301					
275	5.942	0.001 317	0.032 79	1202.25	1387.9	2590.2	1210.07	1574.9	2785.0	3.0208	2.8730	5.8938					
280	6.412	0.001 332	0.030 17	1227.46	1358.7	2586.1	1235.99	1543.6	2779.6	3.0668	2.7903	5.8571					
285	6.909	0.001 348	0.027 77	1253.00	1328.4	2581.4	1262.31	1511.0	2773.3	3.1130	2.7070	5.8199					
290	7.436	0.001 366	0.025 57	1278.92	1297.1	2576.0	1289.07	1477.1	2766.2	3.1594	2.6227	5.7821					
295	7.993	0.001 384	0.023 54	1305.2	1264.7	2569.9	1316.3	1441.8	2758.1	3.2062	2.5375	5.7437					
300	8.581	0.001 404	0.021 67	1332.0	1231.0	2563.0	1344.0	1404.9	2749.0	3.2534	2.4511	5.7045					
305	9.202	0.001 425	0.019 948	1359.3	1195.9	2555.2	1372.4	1366.4	2738.7	3.3010	2.3633	5.6643					
310	9.856	0.001 447	0.018 350	1387.1	1159.4	2546.4	1401.3	1326.0	2727.3	3.3493	2.2737	5.6230					
315	10.547	0.001 472	0.016 867	1415.5	1121.1	2536.6	1431.0	1283.5	2714.5	3.3982	2.1821	5.5804					
320	11.274	0.001 499	0.015 488	1444.6	1080.9	2525.5	1461.5	1238.6	2700.1	3.4480	2.0882	5.5362					
330	12.845	0.001 561	0.012 996	1505.3	993.7	2498.9	1525.3	1140.6	2665.9	3.5507	1.8909	5.4417					
340	14.586	0.001 638	0.010 797	1570.3	894.3	2464.6	1594.2	1027.9	2622.0	3.6594	1.6763	5.3357					
350	16.513	0.001 740	0.008 813	1641.9	776.6	2418.4	1670.6	893.4	2563.9	3.7777	1.4335	5.2112					
360	18.651	0.001 893	0.006 945	1725.2	626.3	2351.5	1760.5	720.5	2481.0	3.9147	1.1379	5.0526					
370	21.03	0.002 213	0.004 925	1844.0	384.5	2228.5	1890.5	441.6	2332.1	4.1106	.6865	4.7971					
374.14	22.09	0.003 155	0.003 155	2029.6	0	2029.6	2099.3	0	2099.3	4.4298	0	4.4298					

TABLE A.2 (SI)
Saturation Pressures (Steam)

Press. kPa <i>P</i>	Temp. °C <i>T</i>	Specific Volume (m ³ /kg)		Internal Energy (kJ/kg)				Enthalpy (kJ/kg)				Entropy (kJ/kg · °K)	
		Sat. Liquid <i>v_f</i>	Sat. Vapor <i>v_g</i>	Sat. Liquid <i>u_f</i>	Sat. Vapor <i>u_g</i>	Evap. <i>u_{fg}</i>	Sat. Vapor <i>u_g</i>	Sat. Liquid <i>h_f</i>	Evap. <i>h_{fg}</i>	Sat. Vapor <i>h_g</i>	Sat. Liquid <i>s_f</i>	Evap. <i>s_{fg}</i>	Sat. Vapor <i>s_g</i>
0.6113	0.01	0.001 000	206.14	.00	2375.3	2375.3	2375.3	.01	2501.3	2501.4	.0000	9.1562	9.1562
1.0	6.98	0.001 000	129.21	29.30	2355.7	2385.0	2385.0	29.30	2484.9	2514.2	.1059	8.8697	8.9756
1.5	13.03	0.001 001	87.98	54.71	2338.6	2393.3	2393.3	54.71	2470.6	2525.3	.1957	8.6322	8.8279
2.0	17.50	0.001 001	67.00	73.48	2326.0	2399.5	2399.5	73.48	2460.0	2533.5	.2607	8.4629	8.7237
2.5	21.08	0.001 002	54.25	88.48	2315.9	2404.4	2404.4	88.49	2451.6	2540.0	.3120	8.3311	8.6432
3.0	24.08	0.001 003	45.67	101.04	2307.5	2408.5	2408.5	101.05	2444.5	2545.5	.3545	8.2231	8.5776
4.0	28.96	0.001 004	34.80	121.45	2293.7	2415.2	2415.2	121.46	2432.9	2554.4	.4226	8.0520	8.4746
5.0	32.88	0.001 005	28.19	137.81	2282.7	2420.5	2420.5	137.82	2423.7	2561.5	.4764	7.9187	8.3951
7.5	40.29	0.001 008	19.24	168.78	2261.7	2430.5	2430.5	168.79	2406.0	2574.8	.5764	7.6750	8.2515
10	45.81	0.001 010	14.67	191.82	2246.1	2437.9	2437.9	191.83	2392.8	2584.7	.6493	7.5009	8.1502
15	53.97	0.001 014	10.02	225.92	2222.8	2448.7	2448.7	225.94	2373.1	2599.1	.7549	7.2536	8.0085
20	60.06	0.001 017	7.649	251.38	2205.4	2456.7	2456.7	251.40	2358.3	2609.7	.8320	7.0766	7.9085
25	64.97	0.001 020	6.204	271.90	2191.2	2463.1	2463.1	271.93	2346.3	2618.2	.8931	6.9383	7.8314
30	69.10	0.001 022	5.229	289.20	2179.2	2468.4	2468.4	289.23	2336.1	2625.3	.9439	6.8247	7.7686
40	75.87	0.001 027	3.993	317.53	2159.5	2477.0	2477.0	317.58	2319.2	2636.8	1.0259	6.6441	7.6700
50	81.33	0.001 030	3.240	340.44	2143.4	2483.9	2483.9	340.49	2305.4	2645.9	1.0910	6.5029	7.5939
75	91.78	0.001 037	2.217	384.31	2112.4	2496.7	2496.7	384.39	2278.6	2663.0	1.2130	6.2434	7.4564
MPa													
0.100	99.63	0.001 043	1.6940	417.36	2088.7	2506.1	2506.1	417.46	2258.0	2675.5	1.3026	6.0568	7.3594
0.125	105.99	0.001 048	1.3749	444.19	2069.3	2513.5	2513.5	444.32	2241.0	2685.4	1.3740	5.9104	7.2844
0.150	111.37	0.001 053	1.1593	466.94	2052.7	2519.7	2519.7	467.11	2226.5	2693.6	1.4336	5.7897	7.2233
0.175	116.06	0.001 057	1.0036	486.80	2038.1	2524.9	2524.9	486.99	2213.6	2700.6	1.4849	5.6868	7.1717
0.200	120.23	0.001 061	0.8857	504.49	2025.0	2529.5	2529.5	504.70	2201.9	2706.7	1.5301	5.5970	7.1271
0.225	124.00	0.001 064	0.7933	520.47	2013.1	2533.6	2533.6	520.72	2191.3	2712.1	1.5706	5.5173	7.0878

TABLE A.2 (SI) (cont'd.)

Press. MPa <i>P</i>	Temp. °C <i>T</i>	Specific Volume		Internal Energy				Enthalpy				Entropy	
		Sat. Liquid <i>v_f</i>	Sat. Vapor <i>v_g</i>	Sat. Liquid <i>u_f</i>	Evap. <i>u_{fg}</i>	Sat. Vapor <i>u_g</i>	Sat. Liquid <i>h_f</i>	Evap. <i>h_{fg}</i>	Sat. Vapor <i>h_g</i>	Sat. Liquid <i>s_f</i>	Evap. <i>s_{fg}</i>	Sat. Vapor <i>s_g</i>	
0.250	127.44	0.001 067	0.7187	535.10	2002.1	2537.2	535.37	2181.5	2716.9	1.6072	5.4455	7.0527	
0.275	130.60	0.001 070	0.6573	548.59	1991.9	2540.5	548.89	2172.4	2721.3	1.6408	5.3801	7.0209	
0.300	133.55	0.001 073	0.6058	561.15	1982.4	2543.6	561.47	2163.8	2725.3	1.6718	5.3201	6.9919	
0.325	136.30	0.001 076	0.5620	572.90	1973.5	2546.4	573.25	2155.8	2729.0	1.7006	5.2646	6.9652	
0.350	138.88	0.001 079	0.5243	583.95	1965.0	2548.9	584.33	2148.1	2732.4	1.7275	5.2130	6.9405	
0.375	141.32	0.001 081	0.4914	594.40	1956.9	2551.3	594.81	2140.8	2735.6	1.7528	5.1647	6.9175	
0.40	143.63	0.001 084	0.4625	604.31	1949.3	2553.6	604.74	2133.8	2738.6	1.7766	5.1193	6.8959	
0.45	147.93	0.001 088	0.4140	622.77	1934.9	2557.6	623.25	2120.7	2743.9	1.8207	5.0359	6.8565	
0.50	151.86	0.001 093	0.3749	639.68	1921.6	2561.2	640.23	2108.5	2748.7	1.8607	4.9606	6.8213	
0.55	155.48	0.001 097	0.3427	655.32	1909.2	2564.5	655.93	2097.0	2753.0	1.8973	4.8920	6.7893	
0.60	158.85	0.001 101	0.3157	669.90	1897.5	2567.4	670.56	2086.3	2756.8	1.9312	4.8288	6.7600	
0.65	162.01	0.001 104	0.2927	683.56	1886.5	2570.1	684.28	2076.0	2760.3	1.9627	4.7703	6.7331	
0.70	164.97	0.001 108	0.2729	696.44	1876.1	2572.5	697.22	2066.3	2763.5	1.9922	4.7158	6.7080	
0.75	167.78	0.001 112	0.2556	708.64	1866.1	2574.7	709.47	2057.0	2766.4	2.0200	4.6647	6.6847	
0.80	170.43	0.001 115	0.2404	720.22	1856.6	2576.8	721.11	2048.0	2769.1	2.0462	4.6166	6.6628	
0.85	172.96	0.001 118	0.2270	731.27	1847.4	2578.7	732.22	2039.4	2771.6	2.0710	4.5711	6.6421	
0.90	175.38	0.001 121	0.2150	741.83	1838.6	2580.5	742.83	2031.1	2773.9	2.0946	4.5280	6.6226	
0.95	177.69	0.001 124	0.2042	751.95	1830.2	2582.1	753.02	2023.1	2776.1	2.1172	4.4869	6.6041	
1.00	179.91	0.001 127	0.1944	761.68	1822.0	2583.6	762.81	2015.3	2778.1	2.1387	4.4478	6.5865	
1.10	184.09	0.001 133	0.1775	780.09	1806.3	2586.4	781.34	2000.4	2781.7	2.1792	4.3744	6.5536	
1.20	187.99	0.001 139	0.1633	797.29	1791.5	2588.8	798.65	1986.2	2784.8	2.2166	4.3067	6.5233	
1.30	191.64	0.001 144	0.1512	813.44	1777.5	2591.0	814.93	1972.7	2787.6	2.2515	4.2438	6.4953	
1.40	195.07	0.001 149	0.1408	828.70	1764.1	2592.8	830.30	1959.7	2790.0	2.2842	4.1850	6.4693	

TABLE A.2 (SI) (cont'd.)

Press. MPa <i>P</i>	Temp. °C <i>T</i>	Specific Volume (m ³ /kg)						Internal Energy (kJ/kg)						Enthalpy (kJ/kg)						Entropy (kJ/kg · °K)					
		Sat. Liquid		Sat. Vapor		Sat. Liquid		Sat. Vapor		Sat. Liquid		Sat. Vapor		Sat. Liquid		Sat. Vapor		Sat. Liquid		Sat. Vapor					
		<i>v_f</i>	<i>v_g</i>	<i>v_f</i>	<i>v_g</i>	<i>u_f</i>	<i>u_g</i>	<i>u_f</i>	<i>u_g</i>	<i>h_f</i>	<i>h_g</i>	<i>h_f</i>	<i>h_g</i>	<i>s_f</i>	<i>s_g</i>	<i>s_f</i>	<i>s_g</i>	<i>s_f</i>	<i>s_g</i>	<i>s_f</i>	<i>s_g</i>				
1.50	198.32	0.001 154	0.131 77	843.16	1751.3	2594.5	844.89	1947.3	2792.2	2.3150	4.1298	6.4448													
1.75	205.76	0.001 166	0.113 49	876.46	1721.4	2597.8	878.50	1917.9	2796.4	2.3851	4.0044	6.3896													
2.00	212.42	0.001 177	0.099 63	906.44	1693.8	2600.3	908.79	1890.7	2799.5	2.4474	3.8935	6.3409													
2.25	218.45	0.001 187	0.088 75	933.83	1668.2	2602.0	936.49	1865.2	2801.7	2.5035	3.7937	6.2972													
2.5	223.99	0.001 197	0.079 98	959.11	1644.0	2603.1	962.11	1841.0	2803.1	2.5547	3.7028	6.2575													
3.0	233.90	0.001 217	0.066 68	1004.78	1599.3	2604.1	1008.42	1795.7	2804.2	2.6457	3.5412	6.1869													
3.5	242.60	0.001 235	0.057 07	1045.43	1558.3	2603.7	1049.75	1753.7	2803.4	2.7253	3.4000	6.1253													
4	250.40	0.001 252	0.049 78	1082.31	1520.0	2602.3	1087.31	1714.1	2801.4	2.7964	3.2737	6.0701													
5	263.99	0.001 286	0.039 44	1147.81	1449.3	2597.1	1154.23	1640.1	2794.3	2.9202	3.0532	5.9734													
6	275.64	0.001 319	0.032 44	1205.44	1384.3	2589.7	1213.35	1571.0	2784.3	3.0267	2.8625	5.8892													
7	285.88	0.001 351	0.027 37	1257.55	1323.0	2580.5	1267.00	1505.1	2772.1	3.1211	2.6922	5.8133													
8	295.06	0.001 384	0.023 52	1305.57	1264.2	2569.8	1316.64	1441.3	2758.0	3.2068	2.5364	5.7432													
9	303.40	0.001 418	0.020 48	1350.51	1207.3	2557.8	1363.26	1378.9	2742.1	3.2858	2.3915	5.6772													
10	311.06	0.001 452	0.018 026	1393.04	1151.4	2544.4	1407.56	1317.1	2724.7	3.3596	2.2544	5.6141													
11	318.15	0.001 489	0.015 987	1433.7	1096.0	2529.8	1450.1	1255.5	2705.6	3.4295	2.1233	5.5527													
12	324.75	0.001 527	0.014 263	1473.0	1040.7	2513.7	1491.3	1193.6	2684.9	3.4962	1.9962	5.4924													
13	330.93	0.001 567	0.012 780	1511.1	985.0	2496.1	1531.5	1130.7	2662.2	3.5606	1.8718	5.4323													
14	336.75	0.001 611	0.011 485	1548.6	928.2	2476.8	1571.1	1066.5	2637.6	3.6232	1.7485	5.3717													
15	342.24	0.001 658	0.010 337	1585.6	869.8	2455.5	1610.5	1000.0	2610.5	3.6848	1.6249	5.3098													
16	347.44	0.001 711	0.009 306	1622.7	809.0	2431.7	1650.1	930.6	2580.6	3.7461	1.4994	5.2455													
17	352.37	0.001 770	0.008 364	1660.2	744.8	2405.0	1690.3	856.9	2547.2	3.8079	1.3698	5.1777													
18	357.06	0.001 840	0.007 489	1698.9	675.4	2374.3	1732.0	777.1	2509.1	3.8715	1.2329	5.1044													
19	361.54	0.001 924	0.006 657	1739.9	598.1	2338.1	1776.5	688.0	2464.5	3.9388	1.0839	5.0228													
20	365.81	0.002 036	0.005 834	1785.6	507.5	2293.0	1826.3	583.4	2409.7	4.0139	.9130	4.9269													
21	369.89	0.002 207	0.004 952	1842.1	388.5	2230.6	1888.4	446.2	2334.6	4.1075	.6938	4.8013													
22	373.80	0.002 742	0.003 568	1961.9	125.2	2087.1	2022.2	143.4	2165.6	4.3110	.2216	4.5327													
22.09	374.14	0.003 155	0.003 155	2029.6	0	2029.6	2099.3	0	2099.3	4.4298	0	4.4298													

TABLE A.3 (SI) (cont'd.)

T	P = 6.0 MPa (275.64)					P = 7.0 MPa (285.88)					P = 8.0 MPa (295.06)				
	v	u	h	s	s	v	u	h	s	s	v	u	h	s	s
700	.073 52	3453.1	3894.2	7.4234	7.3476	.062 83	3448.5	3888.3	7.3476	7.3476	.054 81	3443.9	3882.4	7.3476	7.2812
800	.081 60	3643.1	4132.7	7.6566	7.5822	.069 81	3639.5	4128.2	7.5822	7.5822	.060 97	3636.0	4123.8	7.5822	7.5173
900	.089 58	3837.8	4375.3	7.8727	7.7991	.076 69	3835.0	4371.8	7.7991	7.7991	.067 02	3832.1	4368.3	7.7991	7.7351
1000	.097 49	4037.8	4622.7	8.0751	8.0020	.083 50	4035.3	4619.8	8.0020	8.0020	.073 01	4032.8	4616.9	8.0020	7.9384
1100	.105 36	4243.3	4875.4	8.2661	8.1933	.090 27	4240.9	4872.8	8.1933	8.1933	.078 96	4238.6	4870.3	8.1933	8.1300
1200	.113 21	4454.0	5133.3	8.4474	8.3747	.097 03	4451.7	5130.9	8.3747	8.3747	.084 89	4449.5	5128.5	8.3747	8.3115
1300	.121 06	4669.6	5396.0	8.6199	8.5473	.103 77	4667.3	5393.7	8.5473	8.5473	.090 80	4665.0	5391.5	8.5473	8.4842
P = 9.0 MPa (303.40)															
Sat.	.020 48	2557.8	2742.1	5.6772	5.6141	.018 026	2544.4	2724.7	5.6141	5.6141	.013 495	2505.1	2673.8	5.6141	5.4624
325	.023 27	2646.6	2856.0	5.8712	5.7568	.019 861	2610.4	2809.1	5.7568	5.7568	.016 126	2624.6	2826.2	5.7568	5.7118
350	.025 80	2724.4	2956.6	6.0361	5.9443	.022 42	2699.2	2923.4	5.9443	5.9443	.020 00	2789.3	3039.3	5.9443	6.0417
400	.029 93	2848.4	3117.8	6.2854	6.2120	.026 41	2832.4	3096.5	6.2120	6.2120	.022 99	2912.5	3199.8	6.2120	6.2719
450	.033 50	2955.2	3256.6	6.4844	6.4190	.029 75	2943.4	3240.9	6.4190	6.4190	.025 60	3021.7	3341.8	6.4190	6.4618
500	.036 77	3055.2	3386.1	6.6576	6.5966	.032 79	3045.8	3373.7	6.5966	6.5966	.028 01	3125.0	3475.2	6.5966	6.6290
550	.039 87	3152.2	3511.0	6.8142	6.7561	.035 64	3144.6	3500.9	6.7561	6.7561	.030 29	3225.4	3604.0	6.7561	6.7810
600	.042 85	3248.1	3633.7	6.9589	6.9029	.038 37	3241.7	3625.3	6.9029	6.9029	.032 48	3324.4	3730.4	6.9029	6.9218
650	.045 74	3343.6	3755.3	7.0943	7.0398	.041 01	3338.2	3748.2	7.0398	7.0398	.034 60	3422.9	3855.3	7.0398	7.0536
700	.048 57	3439.3	3876.5	7.2221	7.1687	.043 58	3434.7	3870.5	7.1687	7.1687	.036 69	3520.0	4103.6	7.1687	7.2965
800	.054 09	3632.5	4119.3	7.4596	7.4077	.048 59	3628.9	4114.8	7.4077	7.4077	.042 67	3819.1	4352.5	7.4077	7.5182
900	.059 50	3829.2	4364.8	7.6783	7.6272	.053 49	3826.3	4361.2	7.6272	7.6272	.046 58	4021.6	4603.8	7.6272	7.7237
1000	.064 85	4030.3	4614.0	7.8821	7.8315	.058 32	4027.8	4611.0	7.8315	7.8315	.050 45	4228.2	4858.8	7.8315	7.9165
1100	.070 16	4236.3	4867.7	8.0740	8.0237	.063 12	4234.0	4865.1	8.0237	8.0237	.054 30	4439.3	5118.0	8.0237	8.0987
1200	.075 44	4447.2	5126.2	8.2556	8.2055	.067 89	4444.9	5123.8	8.2055	8.2055	.058 13	4654.8	5381.4	8.2055	8.2717
1300	.080 72	4662.7	5389.2	8.4284	8.3783	.072 65	4460.5	5387.0	8.3783	8.3783					

TABLE A.3 (SI) (cont'd.)

T	P = 25.0 MPa					P = 30.0 MPa					P = 35.0 MPa				
	v	u	h	s	s	v	u	h	s	s	v	u	h	s	s
700	.016 646	3361.3	3777.5	6.6707	6.5707	.013 661	3335.8	3745.6	6.5606	6.5606	.011 533	3309.8	3713.5	6.4631	6.4631
800	.018 912	3574.3	4047.1	6.9345	6.9345	.015 623	3555.5	4024.2	6.8332	6.8332	.013 278	3526.7	4001.5	6.7450	6.7450
900	.021 045	3783.0	4309.1	7.1680	7.1680	.017 448	3768.5	4291.9	7.0718	7.0718	.014 883	3754.0	4274.9	6.9886	6.9886
1000	.023 10	3990.9	4568.5	7.3802	7.3802	.019 196	3978.8	4554.7	7.2867	7.2867	.016 410	3966.7	4541.1	7.2064	7.2064
1100	.025 12	4200.2	4828.2	7.5765	7.5765	.020 903	4189.2	4816.3	7.4845	7.4845	.017 895	4178.3	4804.6	7.4057	7.4057
1200	.027 11	4412.0	5089.9	7.7605	7.7605	.022 589	4401.3	5079.0	7.6692	7.6692	.019 360	4390.7	5068.3	7.5910	7.5910
1300	.029 10	4626.9	5354.4	7.9342	7.9342	.024 266	4616.0	5344.0	7.8432	7.8432	.020 815	4605.1	5333.6	7.7653	7.7653
P = 40.0 MPa															
375	.001 640 7	1677.1	1742.8	3.8290	3.8290	.001 559 4	1638.6	1716.6	3.7639	3.7639	.001 502 8	1609.4	1699.5	3.7141	3.7141
400	.001 907 7	1854.6	1930.9	4.1135	4.1135	.001 730 9	1788.1	1874.6	4.0031	4.0031	.001 633 5	1745.4	1843.4	3.9318	3.9318
425	.002 532	2096.9	2198.1	4.5029	4.5029	.002 007	1959.7	2060.0	4.2734	4.2734	.001 816 5	1892.7	2001.7	4.1626	4.1626
450	.003 693	2365.1	2512.8	4.9459	4.9459	.002 486	2159.6	2284.0	4.5884	4.5884	.002 085	2053.9	2179.0	4.4121	4.4121
500	.005 622	2678.4	2903.3	5.4700	5.4700	.003 892	2525.5	2720.1	5.1726	5.1726	.002 956	2390.6	2567.9	4.9321	4.9321
550	.006 984	2869.7	3149.1	5.7785	5.7785	.005 118	2763.6	3019.5	5.5485	5.5485	.003 956	2658.8	2896.2	5.3441	5.3441
600	.008 094	3022.6	3346.4	6.0114	6.0114	.006 112	2942.0	3247.6	5.8178	5.8178	.004 834	2861.1	3151.2	5.6452	5.6452
650	.009 063	3158.0	3520.6	6.2054	6.2054	.006 966	3093.5	3441.8	6.0342	6.0342	.005 595	3028.8	3364.5	5.8829	5.8829
700	.009 941	3283.6	3681.2	6.3750	6.3750	.007 727	3230.5	3616.8	6.2189	6.2189	.006 272	3177.2	3553.5	6.0824	6.0824
800	.011 523	3517.8	3978.7	6.6662	6.6662	.009 076	3479.8	3933.6	6.5290	6.5290	.007 459	3441.5	3889.1	6.4109	6.4109
900	.012 962	3739.4	4257.9	6.9150	6.9150	.010 283	3710.3	4224.4	6.7882	6.7882	.008 508	3681.0	4191.5	6.6805	6.6805
1000	.014 324	3954.6	4527.6	7.1356	7.1356	.011 411	3930.5	4501.1	7.0146	7.0146	.009 480	3906.4	4475.2	6.9127	6.9127
1100	.015 642	4167.4	4793.1	7.3364	7.3364	.012 496	4145.7	4770.5	7.2184	7.2184	.010 409	4124.1	4748.6	7.1195	7.1195
1200	.016 940	4380.1	5057.7	7.5224	7.5224	.013 561	4359.1	5037.2	7.4058	7.4058	.011 317	4338.2	5017.2	7.3083	7.3083
1300	.018 229	4594.3	5323.5	7.6969	7.6969	.014 616	4572.8	5303.6	7.5808	7.5808	.012 215	4551.4	5284.3	7.4837	7.4837

TABLE 4

t Sat.	Liquid											
	0			2.5 (223.99)			5.0 (263.99)					
p (t Sat.) MPa	$10^3 v$	μ	h	s	$10^3 v$	μ	h	s	$10^3 v$	μ	h	s
0	1.0002	-0.03	-0.03	-0.0001	0.9990	-0.00	2.50	-0.0000	0.9977	0.04	5.04	0.0001
20	1.0018	83.95	83.95	0.2966	1.0006	83.80	86.30	0.2961	0.9995	83.65	88.65	0.2956
40	1.0078	167.56	167.56	0.5725	1.0067	167.25	169.77	0.5715	1.0056	166.95	171.97	0.5705
60	1.0172	251.12	251.12	0.8312	1.0160	250.67	253.21	0.8298	1.0149	250.23	255.30	0.8285
80	1.1291	334.87	334.87	1.0753	1.0280	334.29	336.86	1.0737	1.0268	333.72	338.85	1.0720
100	1.0436	418.96	418.96	1.3069	1.0423	418.24	420.85	1.3050	1.0410	417.52	422.72	1.3030
120	1.0604	503.57	503.57	1.5278	1.0590	502.68	505.33	1.5255	1.0576	501.80	507.09	1.5233
140	1.0800	588.89	588.89	1.7395	1.0784	587.82	590.52	1.7369	1.0768	586.76	592.15	1.7343
160	1.1024	675.19	675.19	1.9434	1.1006	673.90	676.65	1.9404	1.0988	672.62	678.12	1.9375
180	1.1283	762.72	762.72	2.1410	1.1261	761.16	763.97	2.1375	1.1240	759.63	765.25	2.1341
200	1.1581	851.8	851.8	2.3334	1.1555	849.9	852.8	2.3294	1.1530	848.1	853.9	2.3255
210	1.1749	897.1	897.1	2.4281	1.1720	895.0	898.0	2.4238	1.1691	893.0	898.8	2.4195
220	1.1930	943.0	943.0	2.5221	1.1898	940.7	943.7	2.5174	1.1866	938.4	944.4	2.5128
230	1.2129	989.6	989.6	2.6157	1.2092	987.0	990.1	2.6105	1.2056	984.5	990.6	2.6055
240	1.2347	1037.1	1037.1	2.7091	1.2305	1034.2	1037.2	2.7034	1.2264	1031.4	1037.5	2.6979
250	1.2590	1085.6	1085.6	2.8027	1.2540	1082.3	1085.4	2.7964	1.2493	1079.1	1085.3	2.7902
260	1.2862	1135.4	1135.4	2.8970	1.2804	1131.6	1134.8	2.8898	1.2749	1127.9	1134.3	2.8830
270	1.3173	1186.8	1186.8	2.9926	1.3102	1182.4	1185.7	2.9844	1.3036	1178.2	1184.3	2.9766
280	1.3535	1240.4	1240.4	3.0904	1.3447	1235.1	1238.5	3.0808	1.3365	1230.2	1236.8	3.0717
290	1.3971	1297.0	1297.0	3.1918	1.3855	1290.5	1294.0	3.1801	1.3750	1284.4	1291.3	3.1693
300	1.4520	1358.1	1358.1	3.2992	1.4357	1349.6	1353.2	3.2843	1.4214	1341.9	1349.0	3.2708
310									1.4803	1404.1	1411.5	3.3789

FIGURE 5.11a Extract from subcooled table (SI units).

TABLE A.4 (SI)
Properties of Compressed Liquid (Steam)

T	P = 5 MPa (263.99)					P = 10 MPa (311.06)					P = 15 MPa (342.24)				
	v	u	h	s		v	u	h	s		v	u	h	s	
Sat.	.001 285 9	1147.8	1154.2	2.9202		.001 452 4	1393.0	1407.6	3.3596		.001 658 1	1585.6	1610.5	3.6848	
0	.000 997 7	.04	5.04	.0001		.000 995 2	.09	10.04	.0002		.000 992 8	.15	15.05	.0004	
20	.000 999 5	83.65	88.65	.2956		.000 997 2	83.36	93.33	.2945		.000 995 0	83.06	97.99	.2934	
40	.001 005 6	166.95	171.97	.5705		.001 003 4	166.35	176.38	.5686		.001 001 3	165.76	180.78	.5666	
60	.001 014 9	250.23	255.30	.8285		.001 012 7	249.36	259.49	.8258		.001 010 5	248.51	263.67	.8232	
80	.001 026 8	333.72	338.85	1.0720		.001 024 5	332.59	342.83	1.0688		.001 022 2	331.48	346.81	1.0656	
100	.001 041 0	417.52	422.72	1.3030		.001 038 5	416.12	426.50	1.2992		.001 036 1	414.74	430.28	1.2955	
120	.001 057 6	501.80	507.09	1.5233		.001 054 9	500.08	510.64	1.5189		.001 052 2	498.40	514.19	1.5145	
140	.001 076 8	586.76	592.15	1.7343		.001 073 7	584.68	595.42	1.7292		.001 070 7	582.66	598.72	1.7242	
160	.001 098 8	672.62	678.12	1.9375		.001 095 3	670.13	681.08	1.9317		.001 091 8	667.71	684.09	1.9260	
180	.001 124 0	759.63	765.25	2.1341		.001 119 9	756.65	767.84	2.1275		.001 115 9	753.76	770.50	2.1210	
200	.001 153 0	848.1	853.9	2.3255		.001 148 0	844.5	856.0	2.3178		.001 143 3	841.0	858.2	2.3104	
220	.001 186 6	938.4	944.4	2.5128		.001 180 5	934.1	945.9	2.5039		.001 174 8	929.9	947.5	2.4953	
240	.001 226 4	1031.4	1037.5	2.6979		.001 218 7	1026.0	1038.1	2.6872		.001 211 4	1020.8	1039.0	2.6771	
260	.001 274 9	1127.9	1134.3	2.8830		.001 264 5	1121.1	1133.7	2.8699		.001 255 0	1114.6	1133.4	2.8576	
280						.001 321 6	1220.9	1234.1	3.0548		.001 308 4	1212.5	1232.1	3.0393	
300						.001 397 2	1328.4	1342.3	3.2469		.001 377 0	1316.6	1337.3	3.2260	
320											.001 472 4	1431.1	1453.2	3.4247	
340											.001 631 1	1567.5	1591.9	3.6546	

TABLE A.4 (SI) (cont'd.)

T	P = 20 MPa (365.81)					P = 30 MPa					P = 50 MPa						
	v	u	h	s	\int	v	u	h	\int	v	u	h	\int	v	u	h	\int
Sat.	.002 036	1785.6	1826.3	4.0139		.000 985 6	.25	29.82	.0001	.000 976 6	.20	49.03	.0014	.000 976 6	.20	49.03	.0014
0	.000 990 4	.19	20.01	.0004		.000 988 6	82.17	111.84	.2899	.000 980 4	81.00	130.02	.2848	.000 980 4	81.00	130.02	.2848
20	.000 992 8	82.77	102.62	.2923		.000 995 1	164.04	193.89	.5607	.000 987 2	161.86	211.21	.5527	.000 987 2	161.86	211.21	.5527
40	.000 999 2	165.17	185.16	.5646		.001 004 2	246.06	276.19	.8154	.000 996 2	242.98	292.79	.8052	.000 996 2	242.98	292.79	.8052
60	.001 008 4	247.68	267.85	.8206		.001 015 6	328.30	358.77	1.0561	.001 007 3	324.34	374.70	1.0440	.001 007 3	324.34	374.70	1.0440
80	.001 019 9	330.40	350.80	1.0624		.001 029 0	410.78	441.66	1.2844	.001 020 1	405.88	456.89	1.2703	.001 020 1	405.88	456.89	1.2703
100	.001 033 7	413.39	434.06	1.2917		.001 044 5	493.59	524.93	1.5018	.001 034 8	487.65	539.39	1.4857	.001 034 8	487.65	539.39	1.4857
120	.001 049 6	496.76	517.76	1.5102		.001 062 1	576.88	608.75	1.7098	.001 051 5	569.77	622.35	1.6915	.001 051 5	569.77	622.35	1.6915
140	.001 067 8	580.69	602.04	1.7193		.001 082 1	660.82	693.28	1.9096	.001 070 3	652.41	705.92	1.8891	.001 070 3	652.41	705.92	1.8891
160	.001 088 5	665.35	687.12	1.9204		.001 104 7	745.59	778.73	2.1024	.001 091 2	735.69	790.25	2.0794	.001 091 2	735.69	790.25	2.0794
180	.001 112 0	750.95	773.20	2.1147		.001 130 2	831.4	865.3	2.2893	.001 114 6	819.7	875.5	2.2634	.001 114 6	819.7	875.5	2.2634
200	.001 138 8	837.7	860.5	2.3031		.001 159 0	918.3	953.1	2.4711	.001 140 8	904.7	961.7	2.4419	.001 140 8	904.7	961.7	2.4419
220	.001 169 3	925.9	949.3	2.4870		.001 192 0	1006.9	1042.6	2.6490	.001 170 2	990.7	1049.2	2.6158	.001 170 2	990.7	1049.2	2.6158
240	.001 204 6	1016.0	1040.0	2.6674		.001 230 3	1097.4	1134.3	2.8243	.001 203 4	1078.1	1138.2	2.7860	.001 203 4	1078.1	1138.2	2.7860
260	.001 246 2	1108.6	1133.5	2.8459		.001 275 5	1190.7	1229.0	2.9986	.001 241 5	1167.2	1229.3	2.9537	.001 241 5	1167.2	1229.3	2.9537
280	.001 296 5	1204.7	1230.6	3.0248		.001 330 4	1287.9	1327.8	3.1741	.001 286 0	1258.7	1329.0	3.1200	.001 286 0	1258.7	1329.0	3.1200
300	.001 359 6	1306.1	1333.3	3.2071		.001 399 7	1390.7	1432.7	3.3539	.001 338 8	1353.3	1420.2	3.2868	.001 338 8	1353.3	1420.2	3.2868
320	.001 443 7	1415.7	1444.6	3.3979		.001 492 0	1501.7	1546.5	3.5426	.001 403 2	1452.0	1522.1	3.4557	.001 403 2	1452.0	1522.1	3.4557
340	.001 568 4	1539.7	1571.0	3.6075		.001 626 5	1626.6	1675.4	3.7494	.001 483 8	1556.0	1630.2	3.6291	.001 483 8	1556.0	1630.2	3.6291
360	.001 822 6	1702.8	1739.3	3.8772		.001 869 1	1781.4	1837.5	4.0012	.001 588 4	1667.2	1746.6	3.8101	.001 588 4	1667.2	1746.6	3.8101
380																	